

INSTRUCTIONS

GEH-2041A



COMPLETE

**PERMANENT COPY
DO NOT REMOVE FROM
THIS FILE**

MHO DISTANCE RELAY


Type
CEY16A

POWER SYSTEMS MANAGEMENT DEPARTMENT

GENERAL  ELECTRIC

PHILADELPHIA, PA.

GEH-2041 Mho Distance Relay Type CEY

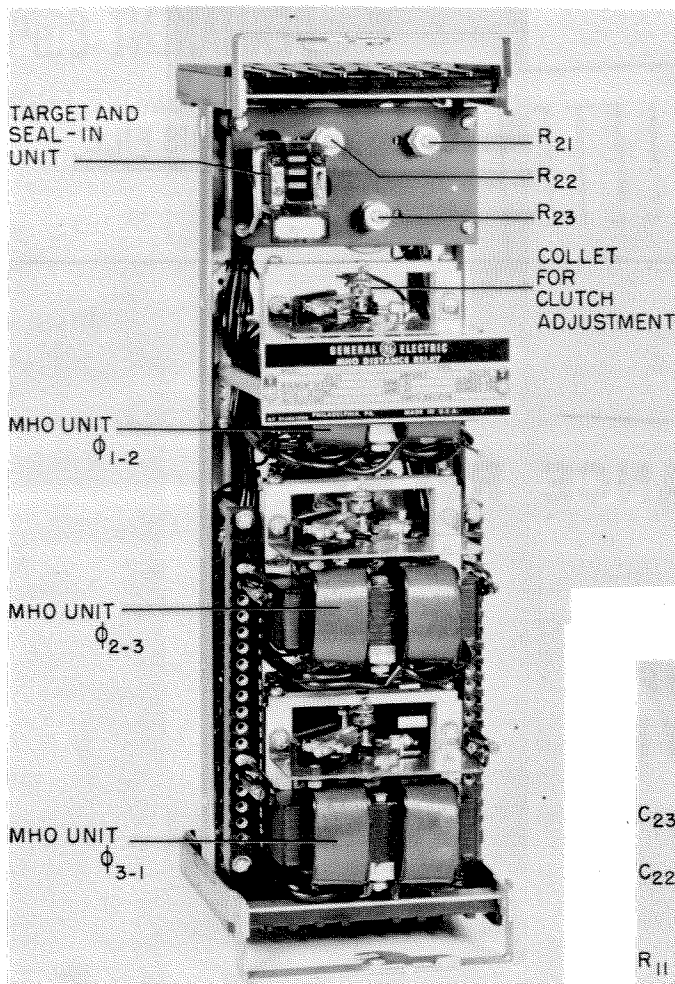


A. Front View

| | |
|-----|---|
| T2 | o |
| 10 | o |
| 8 | o |
| 6 | o |
| 4 | o |
| 2 | o |
| 0 | o |
| 90 | o |
| 80 | o |
| 70 | o |
| 60 | o |
| 50 | o |
| T10 | o |
| 40 | o |
| 30 | o |
| 20 | o |
| 10 | o |
| 0 | o |

LEFT AND RIGHT

B. Tap Numbering Details (Front View)

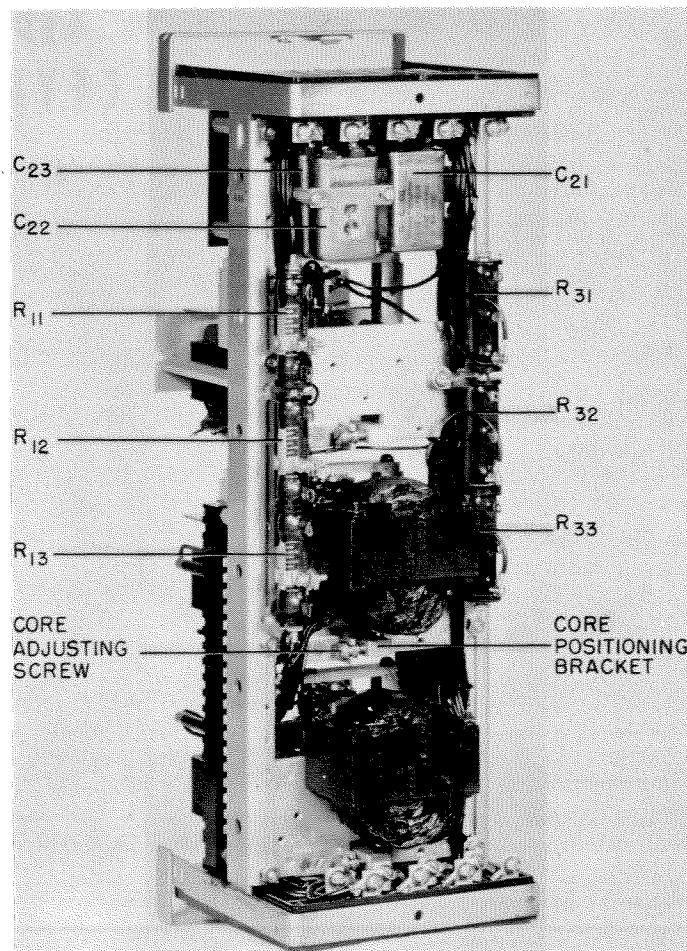

C. Back View

Fig. 1 Mho Distance Relay - CEY16A

Fig. 1A (8028408)

Fig. 1C (8028407)

MHO DISTANCE RELAY CEY16A

DESCRIPTION

INTRODUCTION

The CEY16A relay is a three-phase, high-speed single-zone directional mho distance relay. It is constructed of three single-phase units in one L2 case with provisions for single phase testing. One target and seal-in unit provides indication of operation for all three units. The transient overreach characteristics of the CEY16A have not been limited to the point where it is suitable for use as a first-zone relay. One CEY16A relay in conjunction with a suitable RPM timing relay will provide one zone of time delay protection for three-phase, phase-to-phase and double-phase-to-ground faults.

APPLICATION

The CEY16A because of its high speed and memory action characteristics finds application as a carrier tripping relay in directional comparison schemes, as a permissive and tripping relay in permissive overreaching transferred tripping schemes or as a permissive relay in permissive underreaching transferred tripping schemes. It is also very well suited for use as a second-zone relay in any scheme. The transient overreach characteristic of this relay has not been limited to the point where it is suitable for use as a first-zone relay.

Since the memory action of CEY16A relay is only effective for several cycles after the inception

of a fault, it will not provide time delay protection for any fault that results in zero voltage between the respective terminals of the relay.

When applying this relay for the protection of a given circuit, it is generally advantageous to select the highest ohmic range that can accommodate the desired setting. This is true because the forms with the higher ranges operate at a higher torque level.

The CEY16A and its companion zone packaged (one 3-phase zone per relay) relays may be combined in many ways for use in many different schemes including straight distance protection, directional comparison carrier protection, permissive overreaching and permissive transferred tripping and miscellaneous back-up schemes. Fig. 7 illustrates the external connections to the CEY16A relay when used in conjunction with a CEY15A, CEB17A and an RPM21D for three-zone protection of a transmission circuit against all multiphase faults.

OPERATING CHARACTERISTICS

MHO UNIT

The mho unit has a circular impedance characteristic that passes through the origin of an R-X diagram, and whose center lies on the angle of maximum torque line. The Type CEY mho units are available in the following ratings: (See Table I)

TABLE I
AVAILABLE MHO UNIT RATINGS

| Factory Settings Unless Otherwise Specified | | Other Settings Available by Changing Max. Torque Angle Tap | |
|---|-------------------|--|-------------------|
| Ohmic Range | Max. Torque Angle | Ohmic Range ⁺ | Max. Torque Angle |
| 1-10 | 75° | 0.85-8.5 | 60° |
| 2-20 | 75° | 1.7 -17 | 60° |
| 3-30 | 75° | 2.5 -25 | 60° |

+ These values may vary +5% from above value unless restraint resistor (R₁₁ - R₁₂ - R₁₃) is readjusted. (See RECALIBRATION in SERVICING Section)

These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation, operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.

The minimum ohmic reach is obtained by setting the taps on the autotransformer on 100%. The ohmic reach can be increased by reducing the autotransformer setting, thereby reducing the percentage of the terminal voltage supplied to the restraint circuit. The diameter of the mho unit circular characteristic is the ohmic reach of the unit, at the angle of maximum torque. At any other torque angle, the ohmic reach may be determined from the equation:

$$\text{OHMIC REACH} = \frac{Z_{\min} \cos(\theta - \phi) 100}{(\text{OUTPUT TAP})}$$

Where:

- Output tap = T10 plus T2 tap setting.
- * Z_{\min} = Mho unit minimum phase-to-neutral ohmic reach - Given in Table I.
- θ = Mho unit angle of maximum torque.
- ϕ = Phase angle of the line.

For a 3-30 ohm mho unit set with 100 per cent output tap, and 75 degree angle of maximum torque, the reach of the mho unit would be three ohms if the impedance angle of the line is 75 degrees, current lagging voltage.

Fig. 2 shows typical relay characteristics for the relay.

At reduced voltage, the ohmic value at which the mho unit will operate may be somewhat lower than its calculated value. This "pullback" or reduction in reach, is shown in Fig. 3 where the percentage change in relay reach for a constant tap setting is expressed as a function of the three phase fault current, $I_{3\phi}$, and the relay reach setting Z_{setting} . The mho unit will operate for all points to the right of the curves. The static curves of Fig. 3 were determined by tests performed with no voltage supplied to the relay before the fault was applied. The dynamic curves were obtained with full rated voltage of 120 volts supplied to the relay before the fault was applied. These dynamic curves illustrate the effect of the mho unit memory action which maintains the polarizing voltage on the unit for a few cycles after the inception of the fault.

This memory action is particularly effective at low voltage levels where it enables the mho unit to operate for low fault currents. This can be most forcefully illustrated for a zero voltage fault by referring to Fig. 3. A zero voltage fault must be right at the relay bus and therefore, to protect for this fault, it is imperative that the relay reach zero percent of its setting. Fig. 3 shows the mho unit, under static conditions, will not see a fault at zero percent of the relay setting regardless of the tap setting or the $I_{3\phi} Z_{\text{setting}}$ product. However, under dynamic conditions when the memory action is effective, Fig. 3 shows that a mho unit with a 100 percent tap setting will pick up if the $I_{3\phi} Z_{\text{setting}}$ product is greater than three (3). This means, therefore, that a 3 ohm relay with a 100 percent tap setting; or a Z_{setting} of 3, will pick up if the three phase fault current, $I_{3\phi}$, is greater than 1 ampere.

The memory action will close the contact for only a short period and therefore memory action cannot be relied on if the tripping is delayed. When the relay is used as a second zone relay and tripping is delayed by the zone 2 setting of the type RPM relay the static characteristic should be used. For this application the relay is not required to operate for near-by faults and there will be sufficient voltage to give tripping without depending on memory action.

The mho unit is carefully adjusted to have correct directional action under steady-state low voltage and current conditions. For faults in the tripping direction at the angle of maximum torque of the mho unit, the unit with a 100 per cent tap setting will close its contacts at 1.5 volts and the current values shown in Table VII. For faults in the non-tripping direction, the contacts will remain open at zero volts and between 0 and 60 amperes.

The speed of operation of the mho unit is shown in Figs. 4A and 4B.

TAPPED AUTOTRANSFORMER

The ohmic reach of the mho unit may be adjusted by means of taps on the autotransformer. The autotransformer is tapped in two percent steps from zero to one hundred per cent, and these taps are brought to the two tap blocks. The tap setting is the sum of the two tap settings made on one tap block. The lead marked T2 is screwed into one of the 2% taps and the lead marked T10 is screwed into one of the 10% taps.

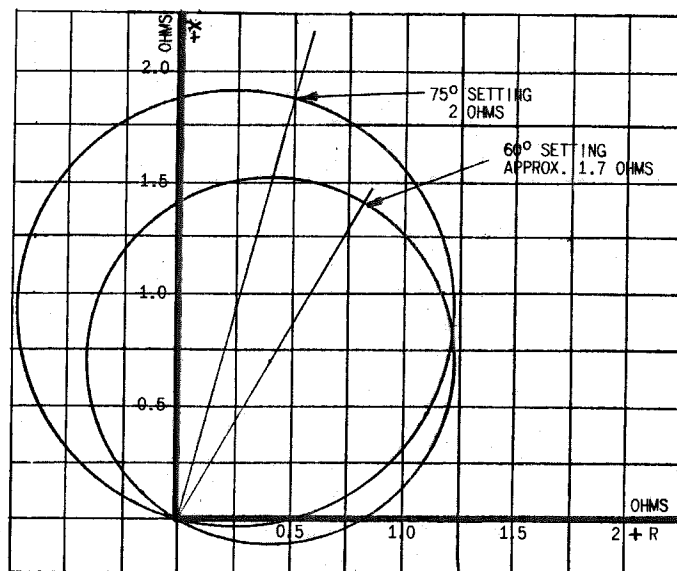


Fig. 2 Minimum Static Operating Characteristics of CEY16A Relay

Fig. 2 (0127A9505-0)

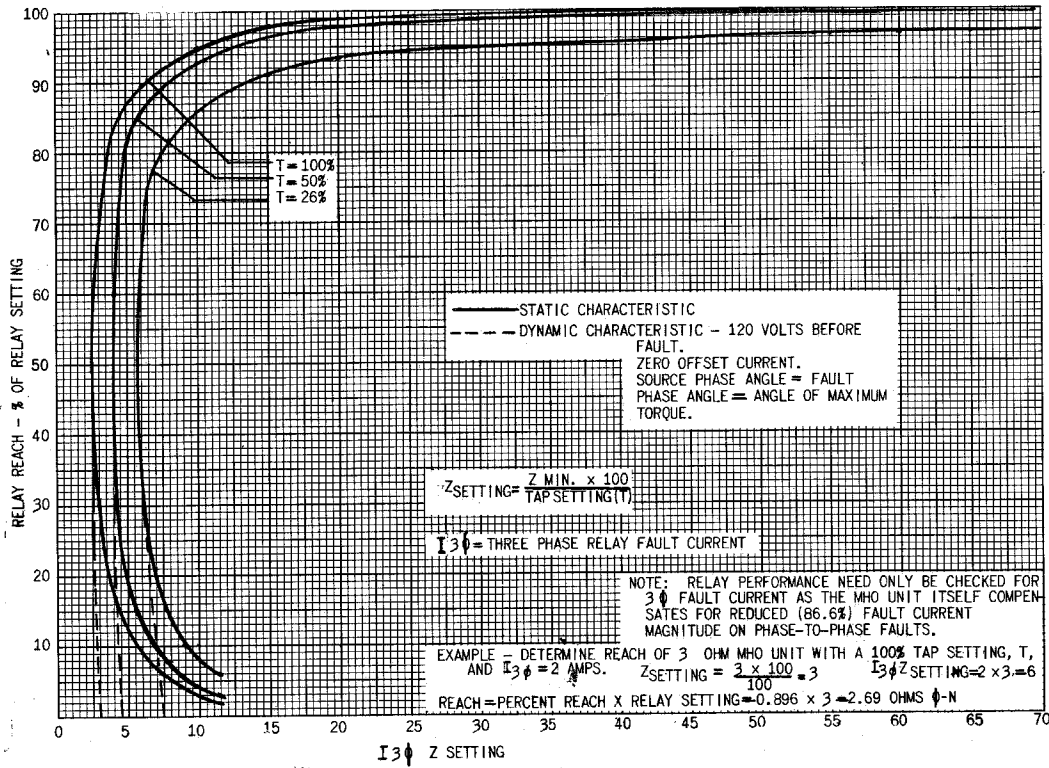


Fig. 3 Static and Dynamic Accuracy Curves of the CEY16A Relay with Mho Unit set at Maximum Angle of Torque

Fig. 3 (0127A7965-1)

Fig. 4A (0127A9444-0) Sh. 1

Fig. 4B (0127A9444-0) Sh. 2

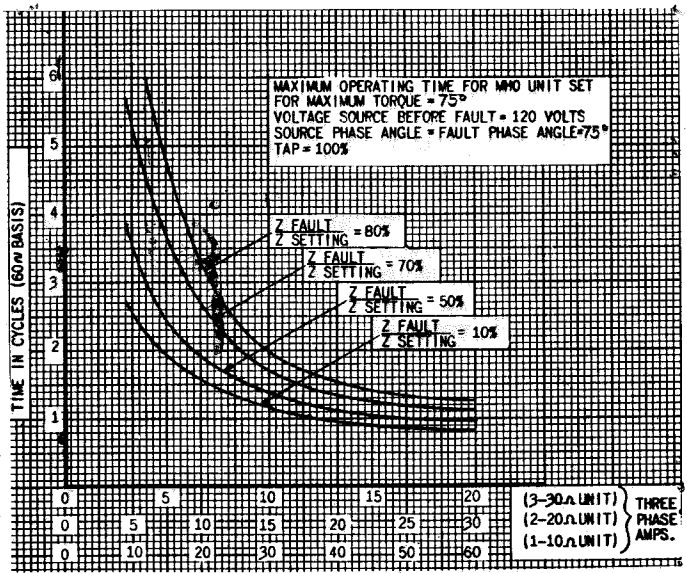
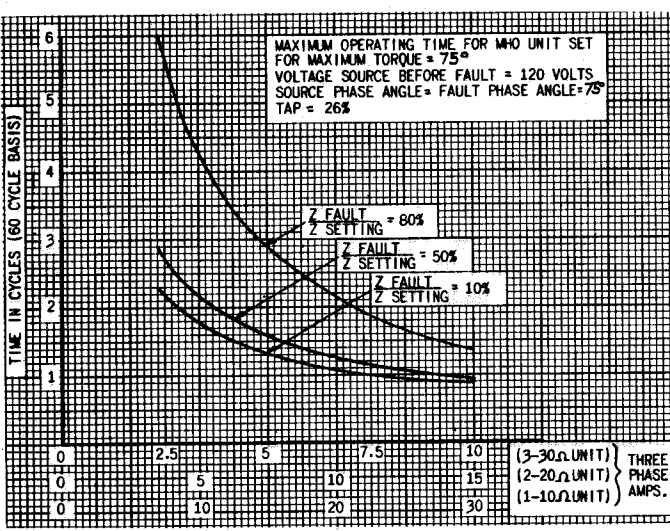


Fig. 4A Time-Current Characteristics

Fig. 4B Time-Current Characteristics

The tap setting required to protect a zone Z ohms long, where Z is the positive phase sequence phase-to-neutral impedance expressed in secondary terms, is determined by the following equation:

$$\text{OUTPUT TAP} = \frac{(100) (\text{MIN. OHMS}) \cos(\phi - \theta)}{Z}$$

The minimum ohms of the mho unit can be found on the relay nameplate.

For a numerical example of the relay tap settings, refer to the "CALCULATIONS" section of this book.

RATINGS

* The Type CEY16A relay is rated 115 volts, 5 amperes. The mho units are available in three ratings, that can be set for maximum torque at 60° lag or 75° lag. The ohmic reach of these units is 1-0, 2-20, or 3-30 if set for 75° lag or 0.85-8.5, 1.7-17, or 2.5-25 if set for 60° lag.

The trip circuit of the relay will close and carry momentarily 30 amperes DC. The breaker trip circuit, however, should always be opened by a circuit breaker auxiliary switch or other suitable means, because the relay contacts cannot interrupt the trip coil current. If the tripping current should exceed 30 amperes it is recommended that an auxiliary tripping relay be used.

The combination target and seal-in unit has a dual rating of 0.6/2.0 amperes. The tap setting used on the target and seal-in unit is determined by the current drawn by the trip coil. The 0.6 ampere tap is used with trip coils which operate on currents ranging from 0.6 amperes to 2.0 amperes at the minimum control voltage. They may also be used with trip coils drawing as much as 30 amperes if the voltage drop caused by the trip current flowing through the 0.6 ohm resistance of the target seal-in coil is not excessive. The 0.6 ampere target seal-in tap can carry 30 ampere for one half second without overheating. The 2.0 ampere target seal-in tap can be used with all trip coils that draw more than 2.0 amperes at minimum control voltage and will carry 30 amperes for 4 seconds without overheating.

TABLE II
TARGET AND SEAL-IN UNIT

| | 2 Amp Tap | 0.6 Amp Tap |
|---------------------------|-----------|-------------|
| DC Resistance | 0.13 ohms | 0.6 ohms |
| Minimum Operating Amperes | 2.0 amps | 0.6 amps |
| Carry Continuously | 4.0 amps | 1.2 amps |
| Carry 30 Amperes for | 4.0 sec. | 0.5 sec. |

The one second thermal ratings of this relay is listed in Table III.

TABLE III
SHORT TIME RATINGS

| OHMIC RANGE | 1 - SEC RATING |
|-------------|----------------|
| 1-10 | 500 amps |
| 2-20 | 500 amps |
| 3-30 | 300 amps |

BURDENS

The current burden imposed on each current transformer at 5 amperes and 60 cycles is listed in Table IV.

TABLE IV
CURRENT BURDEN

| Mho Unit Rating | Watts | Vars | Volt Amps |
|-----------------|-------|------|-----------|
| 1.0 ohm @ 75° | 0.48 | 0.13 | 0.50 |
| 2.0 ohm @ 75° | 0.90 | 0.53 | 1.05 |
| 3.0 ohm @ 75° | 1.30 | 1.20 | 1.77 |

The maximum potential burden imposed on each potential transformer at 115 volts and 60 cycles is listed in Table V.

TABLE V
POTENTIAL BURDEN

| Max. Torque Angle | Watts | Vars | Volt Amps |
|-------------------|-------|------|-----------|
| 60°/75° | 14.5 | 7.0 | 16.1 |

The potential burden of the mho unit is altered by changing the restraint tap setting in order to choose the proper reach. The burden for any set of conditions can be computed by using the equations below:

$$\text{Watts} = 8.2 + \left[\frac{\text{Tap Setting}}{100} \right]^2 \quad (6.3)$$

$$\text{Vars} = \left[\frac{\text{Tap Setting}}{100} \right]^2 \quad (7.0)$$

GENERAL CONSTRUCTION

The mho units of the CEY16A relay are of the four pole induction cylinder construction. The schematic connections for this unit are shown in Fig. 5. The two side poles, energized with phase-to-phase voltage, produce the polarizing flux which

interacts with the flux produced in the back pole energized with a percentage of the same voltage to produce the restraint torque in the relay. The flux produced in the front pole, energized with the two line currents associated with the phase-to-phase voltage used, interacts with the polarizing flux to produce the operating torque. The torque equation at pickup is therefore:

$$\text{Torque} = O = EI \cos(\phi - \theta) - KE^2$$

where E is the phase-to-phase voltage

I is the delta current e.g. $(I_1 - I_2)$

θ is the angle of maximum torque of the relay.

ϕ is the power factor angle

K is a design constant

Dividing through by E^2 and transposing reduces the equation to:

$$Y \cos(\phi - \theta) = K$$

Thus, the relay will pick up at a constant component of admittance at a fixed angle depending upon the maximum torque angle of the unit, hence the name mho unit.

The mho unit contacts are of fine silver for low contact resistance and are of the ideal design of two cylinders at right angles, which provides a point contact without using an actually pointed contact. To protect the contacts from damage caused by high operating torques under short circuit conditions, a felt clutch is provided between the shaft and the contact arm.

A combination target and seal-in unit is mounted at the top of the relay and is connected in series with the tripping circuits.

Fig. 5 (0127A9504-0)

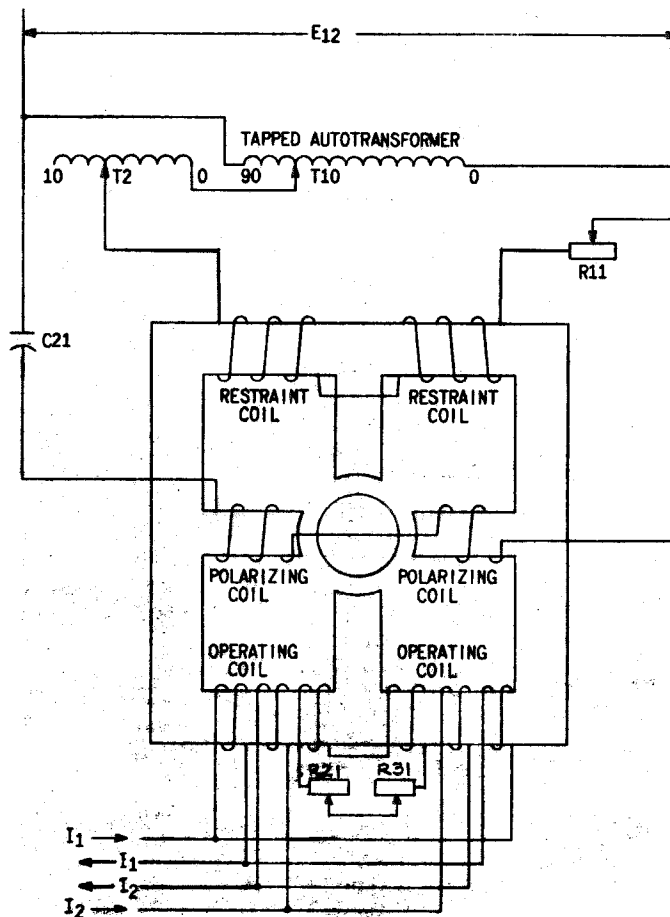


Fig. 5 Schematic Connections of the Mho Unit

Fig. 1, shows the locations of the component parts of the relay visible when the relay is removed from its case.

INSTALLATION

RECEIVING

These relays, when not included as a part of a control panel, will be shipped in cartons designed to protect them against damage. Immediately upon receipt of a relay, examine it for any damage sustained in transit. If injury or damage resulting from rough handling is evident, file a damage claim at once with the transportation company and promptly notify the nearest General Electric Apparatus Sales Office.

Reasonable care should be exercised in unpacking the relay in order that none of the parts are injured or the adjustments disturbed.

If the relays are not to be installed immediately, they should be stored in their original cartons in a place that is free from moisture, dust and metallic chips. Foreign matter collected on the outside of the case may find its way inside when the cover is removed and cause trouble in the operation of the relay.

LOCATION AND MOUNTING

The location should be clean and dry, free from dust and excessive vibration, and well lighted to facilitate inspection and testing.

GEH-2041 Mho Distance Relay Type CEY

The relay should be mounted on a vertical surface. The outline and panel drilling is shown in Fig. 15.

CONNECTIONS

The internal connection diagram for the relay is shown in Fig. 6. A typical wiring diagram is given in Fig. 7.

Unless mounted on a steel panel which adequately grounds the relay case, it is recommended that the case be grounded through a mounting stud or screw with a conductor not less than #12 B & S gauge copper wire or its equivalent.

INSPECTION

Before placing a relay into service, the following mechanical adjustments should be checked, and faulty conditions corrected according to instructions in the ADJUSTMENTS subsection of this section or under the MAINTENANCE section.

The armature and contacts of the target and seal-in unit should operate freely by hand.

There should be a screw in only one of the taps on the right-hand contact of the target and seal-in unit.

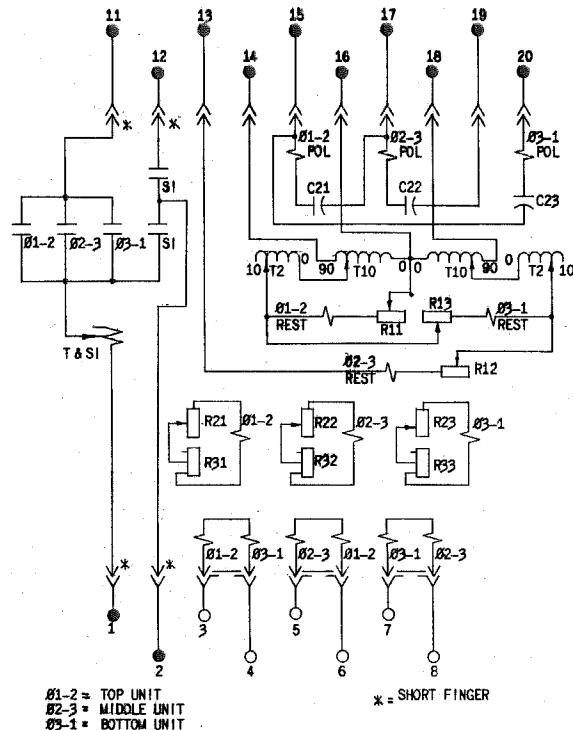


Fig. 6 Internal Connection for CEY16A (Front View)

Fig. 6 (0127A9418-0)

| DEVICE NO. | DEVICE TYPE | INCL. ELEM. | DESCRIPTION |
|------------|---------------|-------------|---|
| 21-21 | CEY15A | | 3 PHASE - 1st. ZONE MHO RELAY |
| | | Ø 1-2 | PHASE 1-2 UNIT ETC. |
| | | T&SI | TARGET & SEAL-IN |
| 21-22 | CEY16A | | 3 PHASE - 2nd. ZONE & CARRIER TRIP MHO RELAY |
| | | Ø 1-2 | PHASE 1-2 UNIT ETC. |
| | | T&SI | TARGET & SEAL-IN |
| 21-23 | CEB17A | | 3 PHASE - 3rd. ZONE & CARRIER START MHO RELAY |
| | | Ø 1-2 | PHASE 1-2 UNIT ETC. |
| | | TRI-2 | PHASE 1-2 TRANSACTOR ETC. |
| | | T&SI | TARGET & SEAL-IN |
| 21X | RPM21D | | TIMING RELAY |
| | | TU | TIMING UNIT |
| | | TX | AUXILIARY FOR TIMING UNIT |
| 50 | PJC31C | | INSTANTANEOUS PHASE FAULT DETECTOR |
| | | T&SI | TARGET & SEAL-IN |
| 94 | HGA14AM or AL | | AUXILIARY TRIPPING RELAY |

| TYPE OR DESCRIPTION | INTERNAL CONNECTIONS | OUTLINE |
|----------------------------|----------------------|-----------|
| CEY15A | 0127A9412 | K-6209276 |
| CEY16A | 0127A9418 | K-6209276 |
| CEB17A | 0127A9413 | K-6209276 |
| RPM21D | 0127A9440 | K-6209270 |
| RPM21D | 0127A9441 | K-6209270 |
| PJC31C | K-6375726 | K-6209276 |
| HGA14AM (BACK CONNS.) | K-6400533 | K-6400533 |
| HGA14AL (FRONT CONNS.) | 377A139 | 377A139 |
| TRIP RECTIFIER (1021218G2) | | 104A8584 |
| TRIP RECTIFIER (1021218G4) | | 104A8584 |

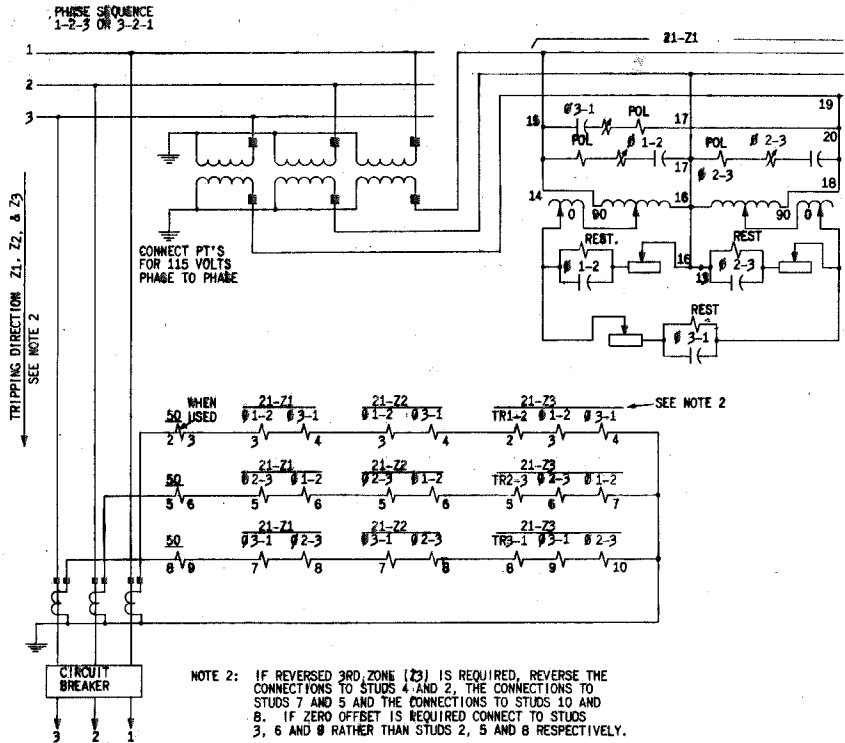


Fig. 7 Typical External Connection

Fig. 7 (7381B21AA-1)

The target should reset promptly when the reset button at the bottom of the cover is operated, with the cover on the relay.

MHO UNITS

There should be no noticeable friction in the rotating structure of the mho unit. The mho unit moving contact should just return to the backstop when the relay is de-energized, and in the vertical position.

There should be approximately 0.003 to 0.006 inch end play in the shafts of the rotating structures. The lower jewel screw bearing should be screwed firmly into place, and the top pivot locked in place by its set screw.

If there is reason to believe that the jewel is dirty the screw assembly can be removed from the bottom of the unit and examined. When replacing a jewel, have the top pivot engaged in the shaft while screwing in the jewel screw.

All nuts and screws should be tight, with particular attention paid to the tap plugs.

The felt gasket on the cover should be securely cemented in place in order to keep out dust.

The contact surfaces should be clean.

The moving contact backstops should be clean. The backstops should be wiped clean at regular intervals with a cloth moistened with carbon tetrachloride solution.

CAUTION

Every circuit in the drawout case has an auxiliary brush. It is especially important on current circuits and other circuits with shorting bars that the auxiliary brush be bent high enough to engage the connecting plug or test plug before the main brushes do. This will prevent CT secondary circuits from being opened.



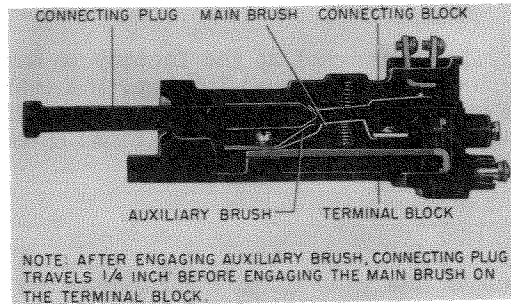


Fig. 8 Cross Section of Drawout Case Showing Position of Auxiliary Brush

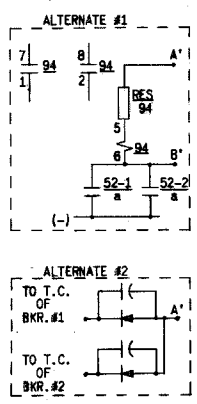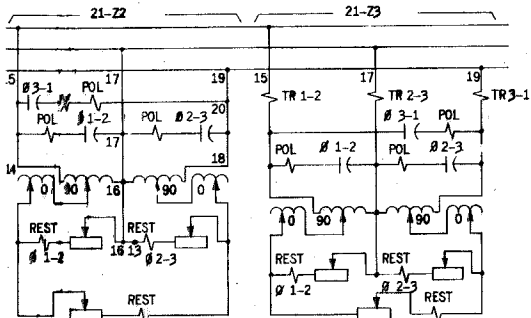

NOTE 1: IF TRIPPING ONLY ONE BREAKER, MAKE CONNECTIONS AS SHOWN AND JUMPER A TO B. IF USING AUXILIARY TRIPPING RELAY (94) TO TRIP TWO BREAKERS, USE CONNECTIONS SHOWN IN ALTERNATE #1 BY CONNECTING A TO A' AND B TO B'. IF RECTIFIERS ARE USED TO TRIP TWO BREAKERS, USE ALTERNATE CONNECTION #2, CONNECT A' TO A AND JUMPER A TO B.

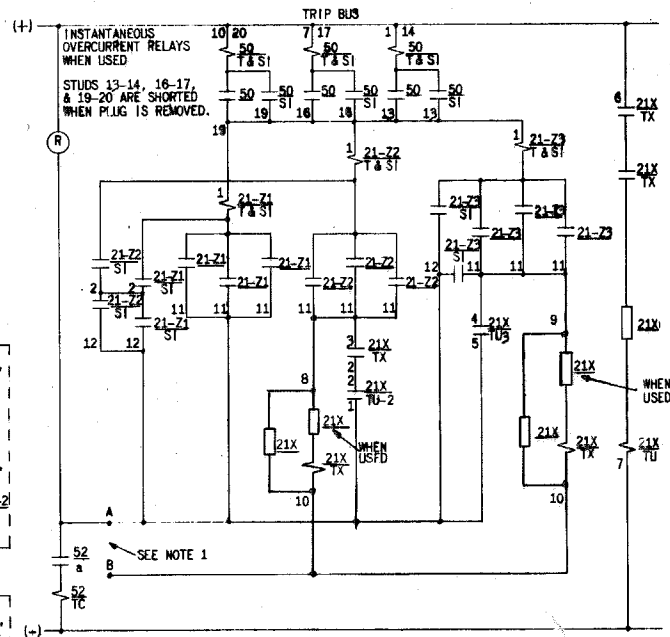


Diagram for CEY16A Relay

ADJUSTMENTS AND TESTS

The relay is properly calibrated at the factory for angle, maximum ohms and minimum reach with 100% tap setting, and it is not advisable to disturb the adjustments. If it is necessary to check the factory calibration of the units or to change the calibration, refer to the MAINTENANCE section of this book where detailed instructions are given under the SERVICING subsection.

MHO UNITS

Angle of Maximum Torque

The relay is calibrated at the factory to have an angle of maximum torque at 75° lag. If a maximum torque angle at 60° lag is desired, the relay can be readjusted as described in the RECALIBRATION section under SERVICING.

Ohmic Reach

The reach of the mho units can be adjusted in two per cent steps by the positioning of the auto-transformer tap leads on the relay tap blocks. To determine the proper tap setting of the mho units, a procedure similar to that outlined in the CALCULATIONS section should be followed.

The calculated tap settings are made by connecting the T10 and T2 tap leads to the proper Taps. The lower tap leads marked T10 (on each tap block) should be connected to one of the 10 percent taps in the lower half of the tap blocks. The upper tap lead (on each tap block) marked T2 should be connected to one of the two percent taps in the upper section of the tap block. The sum of the tap to which the T10 lead is connected and the tap to which the T2 lead is connected should equal the calculated tap setting. For example a tap setting of 86% is made by connecting the T10 lead to the 80% tap and the T2 lead to the 6% tap. The same tap setting must be made on both the right hand and left hand tap blocks.

CAUTION: Examine the tap blocks with great care to make sure the tap lead terminals do not come in contact with adjacent terminals, tap hole shoulders, mounting screw heads, the case or other grounded parts. This may cause a portion of the tapped autotransformer to be shorted or grounded, the result from this being eventual failure of the transformer. The transformer tap leads should be placed horizontally on the tap block with the leads coming out rather than in toward the relay.

Spring Adjustment

The rotating structure of the mho units is not balanced, so that any slight torque caused by a tilt of the relay when installed ready for operation should be compensated using the control spring adjusting arm at the top rear of the unit. First loosen the set screw on the front of the top pivot support, and rotate the control spring adjusting


arm so as to return the contact arm to the backstop, but without supplying enough torque so that the contact would move beyond this position if the stationary contact or backstop were removed. Tighten the set screw permitting approximately 0.003 to 0.006 inch end play to the shaft.

TARGET AND SEAL-IN UNIT

The choice of tap on the target and seal-in unit is described under RATINGS. To change this tap, the spare screw above the left contacts should be inserted into the vacant tap on the right-hand contact, and the other screw removed and placed in the spare position. Do not leave screws in both taps on the right-side of the unit.

OVERALL TESTS

Overall tests on current transformer polarities, potential transformer polarities, relay connections, and wiring can be made on the complete installation. Referring to Fig. 9, a check of the phase angle meter reading will indicate that the relay is receiving the proper voltages and currents if the relay is connected as shown on the typical external connections, Fig. 7.

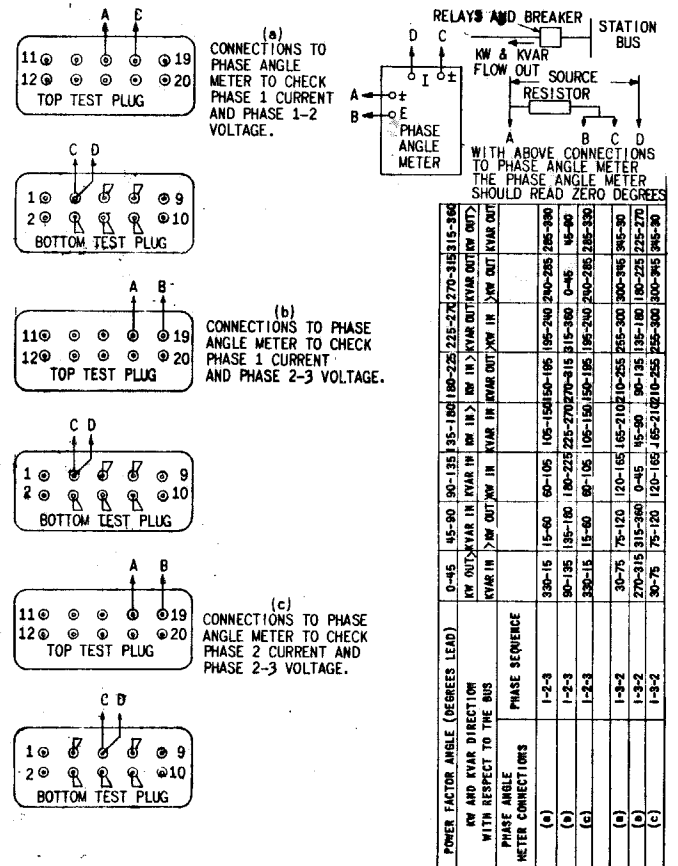

* Fig. 9 Overall Test Connections for Checking of External Wiring to CEY16A Relay

Fig. 9 (0127A7957-1)

To completely check the connection it is necessary to make all three tests ("A", "B", and "C") and if the proper phase angle reading is obtained in all three tests, then the three mho units are receiving the proper voltages and currents. The phase angle meter should be checked using a resistor to determine the correct connection to the phase angle meter to get a zero degree reading. The connections shown in the upper right hand corner of Fig. 9 show the proper connections for one make of phase angle meter.

If sufficient power is flowing into the protected section an approximate check on calibration can be made. This check can be relied on only if the ammeters and wattmeters, or power factor meters are connected to a separate set of current and potential transformers from which the relays are connected, or the connection from the current transformers and potential transformers are known to be right as far as the ammeters, wattmeters and power factor meters are concerned. It is necessary to know this since the reading of the ammeter, wattmeter, and power factor meter will be used to determine the impedance and phase angle seen by the relays. Knowing the impedance and phase angle seen by the relay the tap value at which the relay will just operate can be calculated. It is then only necessary to reduce the tap setting of the relay until the mho units operate and see how close the actual tap value found checks with the calculated value. The calculated value should take into account the shorter reach of the mho unit at low currents. This effect is shown in Fig. 3.


A shorter test which will check for most of the possible open circuits in the AC portion of the relay is as follows: Remove the lower connection plug disconnecting the current circuits. All units should have strong torque to the right when full voltage is applied.

Replace the lower plug and open the restraint taps. All units should operate if power and reactive flow are away from the station bus and into the protected line section. If the direction of reactive power flow is into the station bus, the resultant phase angle may be such that the units will not operate.

ELECTRICAL CHECK TESTS ON THE MHO UNITS

The manner in which reach settings are made for the mho unit is briefly discussed in the introduction of these instructions. It is the purpose of the electrical tests in this section to check the ohmic pickup at the settings which have been made for a particular line section.

To eliminate the errors which may result from possible instrument inaccuracies a test circuit has been selected which requires no instruments to determine the fault impedance. The ammeter is used only to determine the magnitude of the fault current such a circuit is shown in Fig. 10. In Fig. 10, R_S is the source impedance, S is the fault

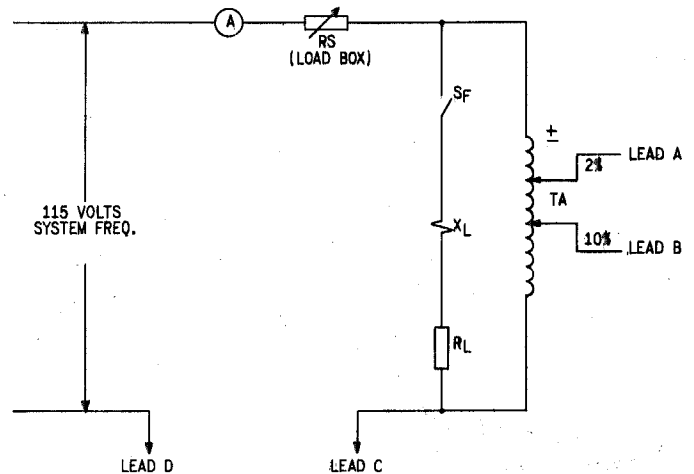

| UNIT LOCATION | UNIT | CONNECT LEAD TO RELAY STUDS AS FOLLOWS | | | | JUMPER RELAY STUDS |
|---------------|-------|--|----------|--------|--------|--------------------|
| | | LEAD A | LEAD B | LEAD C | LEAD D | |
| TOP | Ø 1-2 | 14-15 | 13-16-17 | 3 | 5 | 4-6-8 |
| MIDDLE | Ø 2-3 | 13-16-17 | 18-19-20 | 5 | 7 | 4-6-8 |
| BOTTOM | Ø 3-1 | 18-19-20 | 14-15 | 7 | 3 | 4-6-8 |

Fig. 10 Test Connections for Checking Reach of CEY16A Relay

switch and $RL + jXL$ is the impedance of the line section for which the relay is being tested. The autotransformer, TA, which is across the fault switch and line impedance is tapped in 10 per cent and 1 per cent steps so that the line impedance $RL + jXL$ may be made to appear to the relay very nearly as the actual line on which the relay is to be used. This is necessary since it is not feasible to provide the portable test reactor, XL , and the test resistor with enough taps so that the combination may be made to match any line.

For convenience in field testing the fault switch and tapped autotransformer of Fig. 10 have been arranged in a portable test box, Cat. No. 102L201, which is particularly adapted for testing directional and distance relays. The box is provided with terminals to which the relay current and potential circuits as well as the line and source impedances may be readily connected. For a complete description of the test box the user is referred to GEI-38977.

Other equipment required includes:

- Load Box
- Tapped Test Reactor
- Tapped Test Resistor
- Ammeter
- Test Plugs

Since the reactance of the test reactor may be very accurately determined from its calibration curve, it is desirable to check relay pickup with the

Fig. 10 (0127A9494-0)

fault reactor alone, due account being taken of the angular difference between the line reactance, X_L , and the relay angle of maximum reach. The line reactance, X_L , selected should be the test reactor tap nearest above twice the mho unit reach with account being taken of the difference in angle of the test reactor tap impedance and the relay angle of maximum reach. From Fig. 11 it is seen that twice the relay reach at the angle of the test reactor impedance is:

$$2Z \text{ relay} = 200 \frac{Z \text{ min ohms}}{\text{output tap}} \cos(\phi - \theta) \text{ where } \phi \text{ is}$$

the angle of the test reactor impedance, θ is the relay angle of maximum reach, and "output tap" is the voltage restraint tap setting. The test-box autotransformer percent tap for the mho-unit pickup is given by:

$$\% \text{ tap} = \frac{2Z \text{ relay}}{Z_L} \times 100$$

To illustrate by an example let us consider the percent tap required on the test box autotransformer for a unit that has been factory adjusted to pick up at 3 ohms minimum at a maximum torque angle of 75 degrees. In determining the reactor tap setting to use it may be assumed that the angle (ϕ) of the test reactor impedance is 80 degrees. From the above, twice the relay reach at the angle of the test-reactor impedance is:

$$2Z \text{ relay} = 200 \times \frac{3}{100} \cos(80-75) = 5.98 \text{ ohms}$$

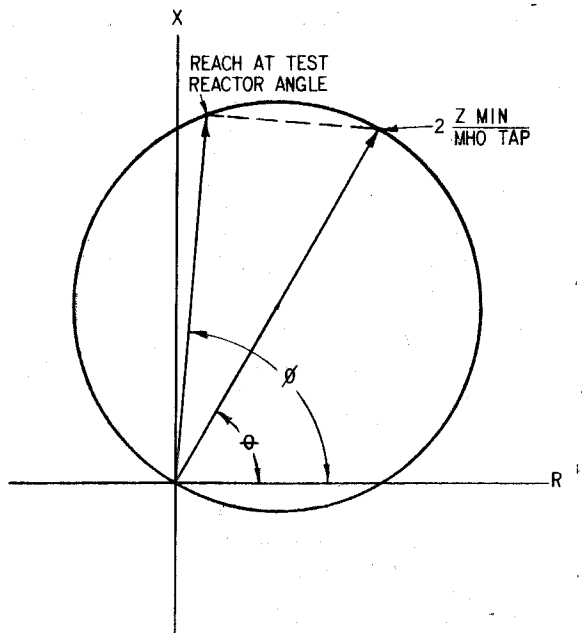


Fig. 11 Diagram Showing Reach CEY16A Mho Unit at the Angle of the Test Reactor

Therefore, use the reactor 6 ohm tap. Twice the relay reach at the angle of test reactor impedance should be recalculated using the actual angle of the reactor tap impedance rather than the assumed 80 degrees. Table VI shows the angles for each of the reactor taps.

TABLE VI

| TAP | ANGLE (ϕ) | COS ($\phi - 75$) |
|-----|------------------|---------------------|
| 24 | 88 | 0.974 |
| 12 | 87 | 0.978 |
| 6 | 86 | 0.982 |
| 3 | 85 | 0.985 |
| 2 | 83 | 0.990 |
| 1 | 81 | 0.995 |
| 0.5 | 78 | 0.999 |

From the table it is seen that the angle of the impedance of the 6 ohm tap is 86 degrees. Therefore:

$$2Z \text{ relay} = 200 \times \frac{3}{100} \cos(86-75) = 5.89 \text{ ohms}$$

The calibration curve for the portable test reactor should again be referred to in order to determine the exact reactance of the 6 ohm tap at the current level being used. For the purpose of this illustration assume that the reactance is 6.1 ohms. Since the angle of the impedance of the 6 ohm tap is 86 degrees, the impedance of this tap may be calculated as follows:

$$Z_L = \frac{X_L}{\sin 86} = \frac{6.1}{.9976} = 6.115$$

From this calculation it is seen that the reactance and the impedance may be assumed the same for this particular reactor tap. Actually the difference need only be taken into account on the reactor 3, 2, 1 and 0.5 ohm taps.

The test box autotransformer tap setting required to close the mho-unit contacts with the fault switch closed is:

$$\% = \frac{5.89}{6.1} (100) = 96.5 \text{ (use 96\% TAP)}$$

Fig. 3 should be checked to determine that the test current used is high enough so that the characteristic is not off the calculated value because of low current.

If the ohmic pickup of the mho unit checks correctly according to the above, the chances are that the angle of the characteristic is correct. The angle may, however, be very easily checked by using the calibrated test resistor in combination with various reactor taps. The calibrated test resistor taps are pre-set in such a manner

Fig. 11 (362A625)

that when used with 12 and 6 ohm taps of the specified test reactor, impedances at 60 degrees and 30 degrees respectively will be available for checking the mho-unit reach at the 60 degree and 30 degree positions. The mho-unit ohmic reach at the zero-degree position may be checked by using the calibrated test resistor alone as the line impedance. The calibrated test resistor is supplied with a data sheet which gives the exact impedance and angle for each of the combinations available. The test-box auto-transformer per cent tap for pickup at a particular angle is given by:

$$\% \text{ Tap} = \frac{200 Z_{\min} \cos(\phi - \theta)}{Z_L (\text{Output Tap})} \times 100$$

where θ is the angle of maximum torque of the unit, " ϕ " is the angle of the test impedance (Z_L), Z_L is the 60 degree, 30 degree or zero degree impedance value taken from the calibrated resistor data sheet and "output tap" is mho unit restraint tap setting. As in the case of the previous tests, the load box which serves as source impedance should be adjusted to allow approximately 10 amperes to flow in the fault circuit when the fault switch is closed.

When checking the mho unit at angles of more than 30 degrees off the maximum reach position, the error becomes relatively large with phase angle error. This is apparent from Fig. 11 where it is seen, for example, at the zero-degree position that a two or three degree error in phase angle will cause a considerable apparent error in reach.

In addition to the above test on the mho units, they may also be checked for directional action with the test box circuits as shown in Fig. 10. The fault resistor R_L may be zero and the test reactor X_L should be set on the 0.5 ohm tap. With connections made as shown, the mho unit contacts should close over the current range as specified in Table VII with 1.5 volts applied across the potential circuit.

TABLE VII

| Minimum Ohmic Reach | 1 | 2 | 3 |
|---------------------|----|----|----|
| Minimum Amperes | 6 | 3 | 2 |
| Maximum Amperes | 60 | 60 | 60 |

TRIP CIRCUIT

If possible, the relay contact circuits should be given an electrical test in place by closing each mho unit contact successively by hand and allowing trip current to pass through the contacts and the target and seal-in unit. The target should promptly appear.

SETTINGS

The reach setting of the CEY16A will generally depend on the line being protected the impedance of the adjacent line sections and the specific scheme

of application. Also important is the phase angle of the protected line section relative to the angle of maximum torque of the relay and the effects of arc resistance.

Referring to Fig. 12 which illustrates the characteristic of the mho unit set for a 60 degree angle of maximum torque, OA represents the reach setting and OB is the maximum permissible reach for coordination purposes with adjacent circuits. If arc resistance for a fault at A is given by AC , then the impedance as seen by the relays at O for such a fault would be OC . This is outside of the relay characteristic and would have to be tripped by some other relay with a larger reach setting.

If the protected line has an impedance that plots to the left of the crest of the mho circle, such as OD then the effect of fault resistance FE for a fault at F is to bring the total impedance into the tripping circle at E causing the relay to overreach slightly. This situation can result with the 60 degree setting only when the line impedance angle is greater than 75 degrees. If such a situation is encountered, the relay reach setting may be reduced enough to compensate for it. With a 75 degree angle of maximum torque setting this effect will be very small and may be neglected.

The reach of the relay at any given impedance angle in terms of its reach at the set angle is given by the following expression:

$$Z_R = Z_M \cos(\phi - \theta)$$

where:

θ = maximum torque angle of relay

ϕ = angle of impedance to the fault.

Z_M = relay reach in secondary ohms at angle of maximum torque. (θ)

Z_R = relay reach in secondary ohms at impedance angle. (ϕ)

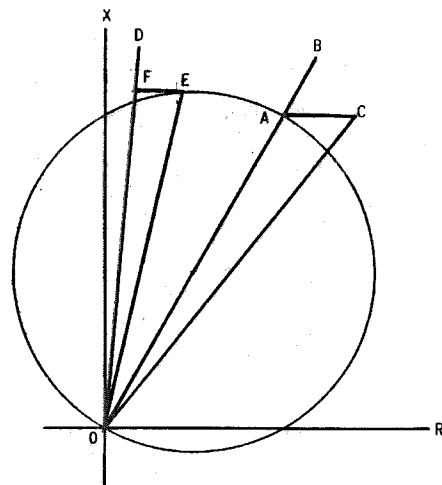


Fig. 12 Effect of Arc Resistance on Impedance as Seen by Mho Units

Fig. 12 (0127A9521-0)

SAMPLE CALCULATIONS

Consider a 230 KV transmission line 50 miles long having a phase to neutral impedance of:

$$Z_{\text{prim}} = 0.14 + j 0.80 \text{ ohms per mile}$$

$$Z_{\text{prim}} = 50 (0.14 + j 0.80) = 7 + j 40 \text{ ohms total}$$

$$\text{PT Ratio} = 230,000/115 = 2000/1$$

$$\text{CT Ratio} = 600/5 = 120/1$$

$$Z_{\text{sec}} = Z_{\text{prim}} \frac{\text{CT Ratio}}{\text{PT Ratio}}$$

$$Z_{\text{sec}} = (7.0 + j 40.0) \frac{120}{2000} = 0.42 + j 2.4 \text{ ohms}$$

$$Z_{\text{sec}} = 2.43 \angle 80.5^\circ \text{ ohms}$$

Assume that the CEY16A is to be used to provide second zone protection and it is desired, after considering the effects of infeed, to set the relay to reach $3.64 \angle 80.5^\circ$ secondary ohms.

For this application the highest suitable range is 3-30 ohms. Thus, the 3 ohm relay will be selected.

The ohmic reach equation, given in the section under "OPERATING CHARACTERISTICS-TAPPED AUTO TRANSFORMER" is used.

$$\text{Output Tap} = \frac{(100) (\text{Minimum Ohms}) \cos (\phi - \theta)}{Z}$$

$$\text{Minimum Ohms} = 3.0$$

$$Z = Z_{\text{sec}} = 3.64$$

$$\theta = 75^\circ$$

$$\phi = 80.5^\circ$$

$$\text{Output Tap} = \frac{(100) (3.0) \cos (80.5 - 75)}{3.64}$$

$$\text{Output Tap} = \frac{(300) \cos (5.5)}{3.64}$$

$$\text{Output Tap} = 82.2$$

Set T10 on 80 and set T2 on 2.

MAINTENANCE

PERIODIC TESTING

An operation test and an inspection of each relay unit and seal-in unit are recommended at least once every six months. The inspection of the relay should be made as outlined in the INSPECTION subsection of the INSTALLATION section. The check tests should be those described in the ELECTRICAL CHECK TESTS subsection of the INSTALLATION section. These check tests may be made very quickly if the test box autotransformer settings for each relay terminal are determined ahead of time. In that case, it is only necessary to insert the test plugs in each relay in succession and observe relay contact operation when the fault switch is closed. Frequent CALIBRATION tests are not considered necessary since the calibration of the relay does not change appreciably with time. If it is found that the relay does not check test correctly, recalibration may be made according to the procedures set forth under SERVICING in this section.

CONTACT CLEANING

For cleaning the fine silver contacts, a flexible burnishing tool should be used. This consists of a flexible strip of metal with an etched roughened surface, resembling in effect a superfine file. The polishing action is so delicate that no scratches are left, yet corroded material will be removed rapidly and thoroughly. The flexibility of the tool insures the cleaning of the actual points of contact.

Fine silver contacts should not be cleaned with knives, files, or abrasive paper or cloth. Knives or files may leave scratches which increase arcing and deterioration of the contacts. Abrasive

paper or cloth may leave minute particles of insulating abrasive material in the contacts and thus prevent closing.

The burnishing tool described is included in the standard relay tool kit obtainable from the factory.

SERVICING

MHO UNIT

a. Contact Adjustment

The contacts of the mho unit should have an 0.018-0.022 inch gap when open, and should have no wipe beyond that due to the compressibility of the felt backstop. Fig. 13 illustrates the mho unit contact adjustments required to obtain proper operation. The gaps should be set by suitable thickness gages.

b. Control Spring Adjustment

After the CEY relay has been mounted the control spring of the mho unit should be adjusted so that the moving contact will just return to the right backstop when the relay is de-energized. It should be set so that if the backstop were removed, the moving contact would not move further to the right. This adjustment should be made by using the control spring adjusting arm at the top rear of the mho unit. First loosen the set screw on the front of the top pivot support, and then rotate the control spring adjusting arm so as to return the contact arm to the backstop. Tighten the set screw permitting 0.003-0.006 inch end play to the shaft. The clutch should then be slipped mech-

anically and the reset position of the contact observed. This test should be repeated, and the control spring adjusted so that the moving contact will return to the backstop for all cup positions.

c. Clutch Setting

The clutch of the mho unit is set to slip when a force of from 45 to 55 grams is applied to the moving contact assembly at the moving contact.

The clutch on the mho unit is adjusted by means of the steel collar at the upper end of the rotating shaft. To adjust the clutch, loosen the set screw in the collar, rotate the collar on the shaft through the number of half turns necessary to obtain the correct pressure. Moving the collar down increases the clutch pressure. The collar should then be locked by means of the set screw which seats itself in a groove provided on the shaft. Care should be taken to seat the set screw in this groove rather than tighten it against the threaded shaft.

d. Polarity

To check the polarity of the mho unit, the connections of Fig. 14A may be used. With these connections and the mho unit taps on 100 per cent, the mho unit contacts should remain open. The correct polarity for the mho unit is indicated by the closing of the left-hand contact of the mho unit when the T2 tap leads are removed from the autotransformer tap blocks.

e. Directional

To check the directional action of the mho unit, the connections of Fig. 14B should be used. Set the

mho unit's taps on 100 per cent. With the connections of Fig. 14B adjust the phase shifter to the angle of maximum torque. With 1.5 volts applied to the potential circuit, the mho unit contact should be closed over the range given in Table VII under ELECTRICAL CHECK TESTS. With the current connections at the relay terminals reversed from that shown in Fig. 14B, the voltage removed from the relay and short the relay potential terminals, the contact of the mho unit should remain open from 0 to 60 amperes.

If the mho unit fails to perform properly at these high current levels, the inner stator, or core, should be adjusted to the left or right a small amount. To accomplish this, first loosen the hex head nut in the bottom rear of the mho unit. This nut clamps the core positioning bracket. Once this nut is loosened, the core can be moved from side to side by means of the core adjusting screw mounted on the rear of the mho unit mounting plate. This adjusting screw is accessible from the right side of the relay. If the mho unit contact fails to close at the high current level, turn the core adjusting screw slightly clockwise. If the mho unit contact fails to open properly at the high current level, turn the core adjusting screw slightly counter-clockwise. After an adjustment of the screw in either direction, back it off slightly in the opposite direction to relieve tension on the screw.

f. Recalibration

Before pickup or phase angle checks are made, the mho unit should be allowed to heat up for approximately 15 minutes energized with rated voltage alone. When cold the relay tends to underreach by 3 or 4 per cent. If the relay is permitted to warm

Fig. 13 (0127A7968-0)

Fig. 14 (0127A7969-0)

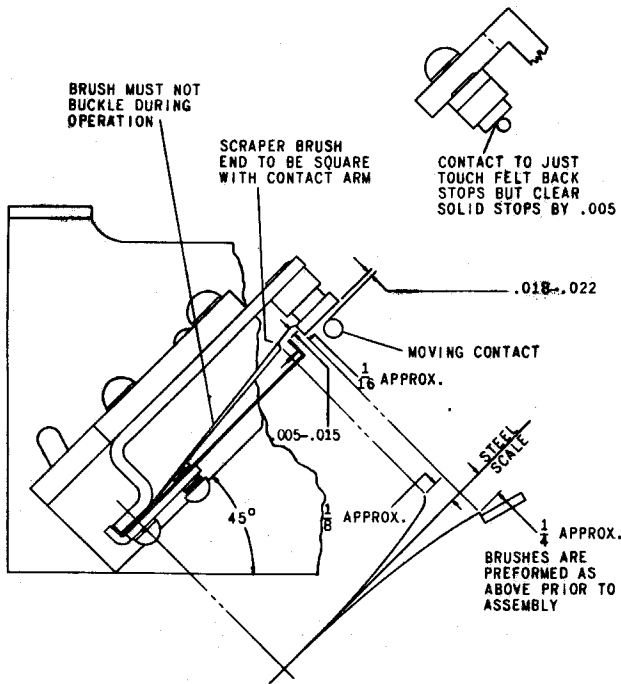


Fig. 13 Mho Unit Contact Adjustments

| CONNECTIONS TO TEST EACH UNIT | | | |
|-------------------------------|-------------|-------------|--------|
| TOP UNIT | MIDDLE UNIT | BOTTOM UNIT | |
| LEAD 1 | LEAD A | LEAD B | LEAD C |
| LEAD 2 | LEAD B | LEAD C | LEAD A |
| LEAD 3 | LEAD D | LEAD E | LEAD F |
| LEAD 4 | LEAD E | LEAD F | LEAD D |

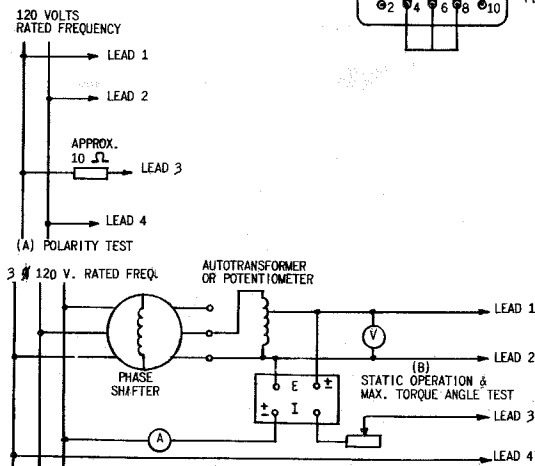



Fig. 14 Test Connections for Checking Mho Unit Operation

up, the error due to temperature will be less than one per cent.

* If the pickup of the mho unit is to be calibrated by test, use the connections of Fig. 14B. Carefully calibrated meters are an absolute necessity if the relay calibration tests are to be carried successfully. Adjust the voltage to the desired level. When setting low values of impedance, it is advisable to use approximately 55 volts to avoid excessive currents. Adjust the phase angle to the angle of maximum torque of the mho unit. Increase the current to determine the mho unit pickup current. The impedance calculated from the ratio of the voltage and current readings with the connections of Fig. 14B corresponds to the phase-to-phase impedance, and is double the phase-to-neutral or relay impedance. If the contact does not close at the correct current, the setting of the rheostat, R₁, R₂, or R₃ should be changed. Rotating the rheostat setting clockwise decrease the pickup current.

If angular settings are to be checked, use the connections of Fig. 14B with about 55 volts on the relay, and current sufficiently high to cause the contacts to close over a span of 90 degrees

or more. Turn the phase shifter and find the two values of phase angle at which the contacts will just close (always taking the reading as contacts move from open to closed position), maintaining the same voltage and current when both angles are read. The angle midway between these two values is the angular setting of the unit, or its angle of maximum torque. If the angle of maximum torque is not correct it can be corrected by adjusting R₂₁, R₂₂, or R₂₃, depending on whether it is the top, middle, or bottom unit being adjusted.

RENEWAL PARTS

It is recommended that sufficient quantities of renewal parts be carried in stock to enable the prompt replacement of any that are worn, broken, or damaged.

When ordering renewal parts, address the nearest Sales Office of the General Electric Company, specify quantity required, name of part wanted, and give complete nameplate data, including serial number. If possible, give the General Electric Company requisition number on which the relay was furnished.

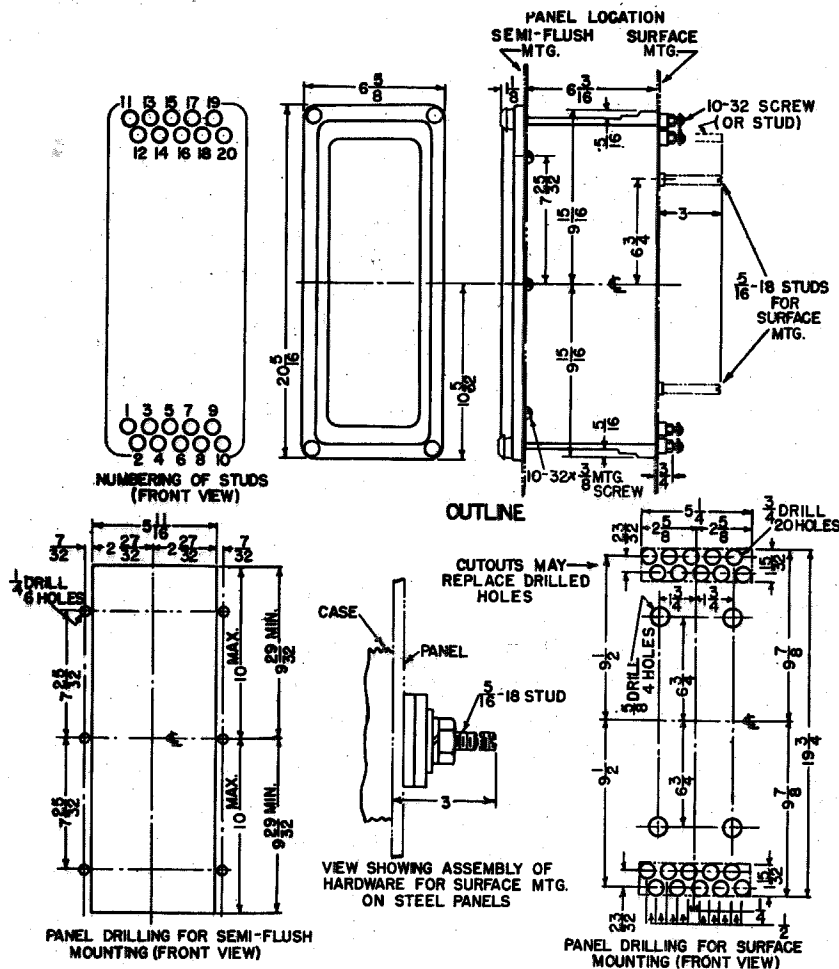


Fig. 15 Outline and Panel Drilling Diagram for CEY16A

Fig. 15 (6209276-1)

* Denotes change since superseded issue.