



INSTRUCTIONS

INSTANTANEOUS OVERCURRENT RELAY

TYPE HFC

HFC99AA


INTRODUCTION

These instructions, in addition to those in GEK-49826, constitute the complete set of instructions for the HFC99AA relay.

DESCRIPTION

This relay is similar to HFC23C, described in instruction book GEK-49826, except that it has one set of electrically separate contacts, as shown in the Internal Connections Diagram in Figure 1 of this supplement.

These instructions do not purport to cover all details or variations in equipment nor provide for every possible contingency to be met in connection with installation, operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company. To the extent required the products described herein meet applicable ANSI, IEEE and NEMA standards; but no such assurance is given with respect to local codes and ordinances because they vary greatly.

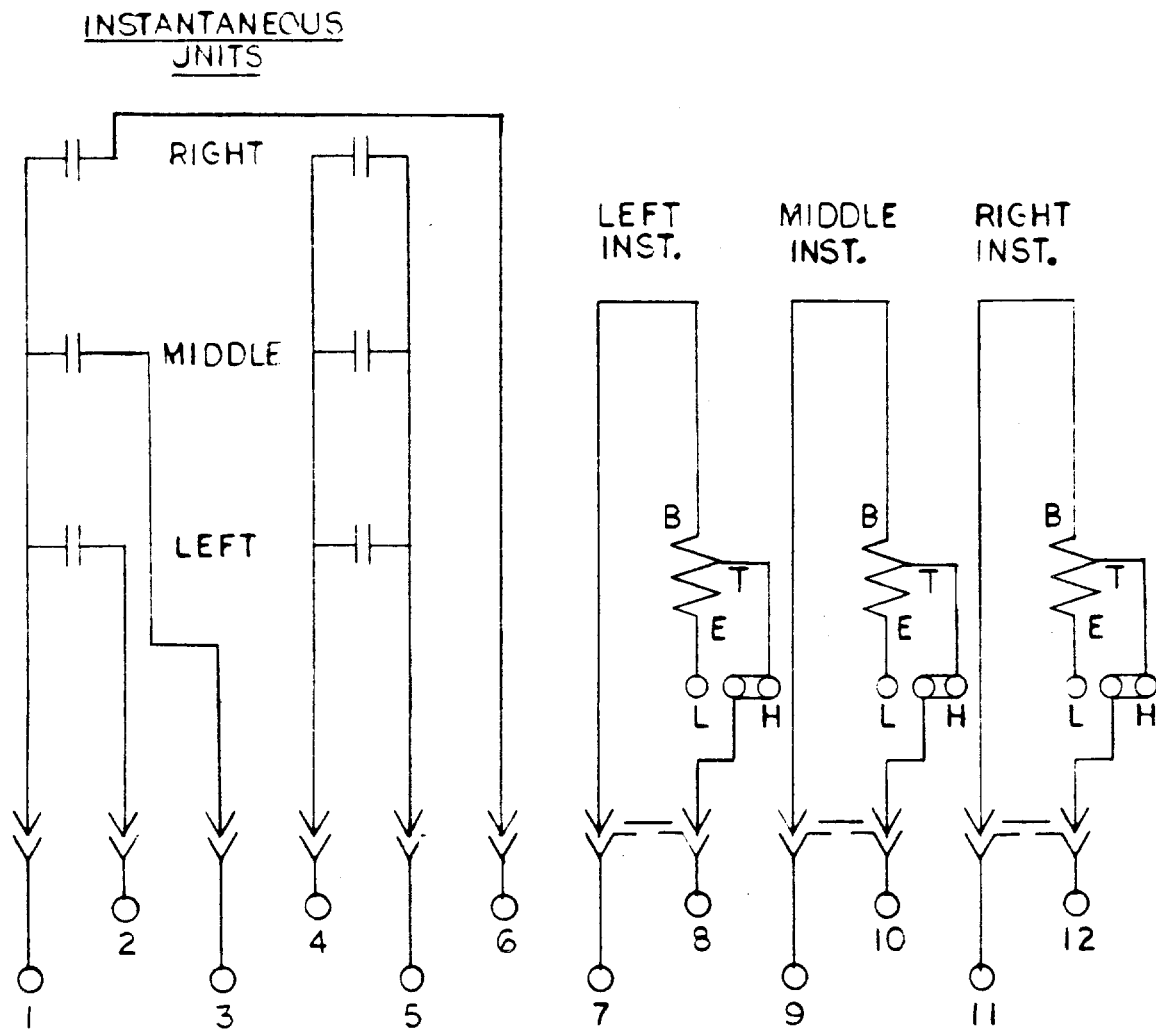

INSTANTANEOUS SETTINGS

SET LINK TO "H" FOR HIGH RANGE
 AND TO "L" FOR LOW RANGE.
 LINK SHOWN IN HIGH RANGE POSITION.

Fig. 1 (0285A5439-0) Internal Connections Diagram for HFC99AA(-)A Relay