



# INSTRUCTIONS

GEK-49805

STATIC OUTPUT AND TRIPPING UNIT

TYPE SLAT54H

---

**POWER SYSTEMS MANAGEMENT DEPARTMENT**

**GENERAL  ELECTRIC**

**PHILADELPHIA, PA.**

TABLE OF CONTENTS

	PAGE
DESCRIPTION.....	3
APPLICATION AND SETTINGS.....	3
RATINGS.....	3
BURDEN.....	4
FUNCTIONS.....	4
CONTACT TRIP CIRCUIT.....	4
RI-1Ø RECLOSE INITIATE CIRCUIT.....	4
BFI BREAKER FAILURE INITIATE CIRCUITS.....	4
AUXILIARY REED RELAY OUTPUTS.....	4
CONTACT CONVERTERS.....	4
PHASE VOLTAGE LEVEL DETECTORS.....	4
TARGETS.....	4
LOGIC CIRCUITS.....	5
CONSTRUCTION.....	5
RECEIVING, HANDLING AND STORAGE.....	5
TEST INSTRUCTIONS.....	6
CAUTION.....	6
GENERAL.....	6
OPERATIONAL CHECKS.....	6
TEST CARD ADAPTER.....	6
TIMER ADJUSTMENTS AND TESTS.....	6
TRIP CIRCUIT TESTS.....	7
PHASE UNDERVOLTAGE DETECTORS.....	7
OVERALL EQUIPMENT TESTS.....	7
MAINTENANCE.....	7
PERIODIC TESTS.....	7
TROUBLESHOOTING.....	7
SPARE PARTS.....	8

STATIC OUTPUT AND TRIPPING UNITTYPE SLAT54HDESCRIPTION

The SLAT54H is a static logic and output unit, intended for use in a single pole tripping and reclosing scheme. The SLAT54H is intended for use with other units, such as a SLYP positive distance unit, a SLCN negative sequence directional overcurrent unit, a SLS breaker pole selection unit, a SLA52 auxiliary logic unit, a SLAT54 output auxiliary unit, a SSA power supply, and a test panel. This group of units form a single or three pole tripping directional comparison scheme when used with appropriate channel facilities. The main purpose of the SLAT54H is to provide the additional logic and trip output required for a single pole tripping scheme over that required for a three pole tripping scheme.

APPLICATION AND SETTINGS

The SLAT54H is an integral part of an overall scheme and reference should be made to the overall logic diagram description for both application and setting information.

RATINGS

The Type SLAT54H relay is designed for use in an environment where the ambient temperature around the relay case is between -20°C and +65°C.

The Type SLAT54H relay requires a ±15VDC power source which can be obtained from a Type SSA50/51 power supply.

The telephone relays in the trip circuits, TR1 and TR2, are rated for relay voltage. Each has a series target which operates when 1.0 ampere is passed through the trip circuit. The trip contacts will make and carry three amperes continuously. They will make and carry 30 amperes for one second. Contact rating is 180 volt-ampere resistive, 60 volt-ampere inductive.

The contacts of the reclose initiate (RI) relay will make and carry three amperes continuously; they will make and carry 30 amperes for one second. These contacts will interrupt up to 180 volt-amperes resistive (60 volt-amperes inductive).

The contacts of the BFI-A, BFI-B, and BFI-C reed relays will make and carry three amperes for tripping duty and are continuously rated for three amperes. The contacts will interrupt up to 100 volt-amperes resistive (35 volt-amperes inductive).

The contacts of the reed relays that are used for RR51, RR52, RR53 and RR54 are rated for 10 volt-amperes. They will carry 0.5 ampere continuously.

Each contact converter in this relay has a link for selecting the proper voltage for the coil circuit of the contact converter. The available voltage taps are for 48, 125, or 250 VDC.

Refer to the unit nameplate for the trip circuit rating of a particular relay.

*These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation, operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.*

*To the extent required the products described herein meet applicable ANSI, IEEE and NEMA standards; but no such assurance is given with respect to local codes and ordinances because they vary greatly.*

BURDEN

The SLAT54H relay presents a maximum burden to the Type SSA power supply of:

200 ma from the +15 VDC supply.

200 ma from the -15 VDC supply.

FUNCTIONS

Not all of these functions will be supplied on every unit. Refer to the unit nameplate or associate overall logic for the included functions.

CONTACT TRIP CIRCUIT

Two fast acting, telephone relay trip circuits are provided. When used as part of a scheme, one trip circuit is used for phase "B", and one for phase "C". Each circuit provides two, electrically separate, normally open contacts. Each contact can carry trip duty current (up to 30 amperes for one second). Each contact closes within four milliseconds from the time its associated coil is energized, and drops within 16 milliseconds from the time its coil is deenergized.

RI-1Ø RECLOSE INITIATE CIRCUIT

Two electrically separate normally open contacts are provided. These contacts close within 17 milliseconds from the time the associated coil is energized by the logic. The contacts open within 170 milliseconds from the time the coil is deenergized. The RI-1Ø function uses a telephone-type relay with contact ratings stated under RATINGS.

BFI BREAKER FAILURE INITIATE CIRCUITS

Three sets of contacts are provided, one set for each phase. Each set consists of two electrically separate, normally open contacts. These contacts close within two milliseconds of the time the associated coil is energized by the logic. The contacts open within two milliseconds of the time the coil is deenergized. The BFI functions use reed relays with contact ratings as stated under RATINGS.

AUXILIARY REED RELAY OUTPUTS

The usage of reed relays RR51, RR52, RR53 and RR54, is determined by the particular scheme in which the SLAT54H is employed. Each relay has one normally open contact whose rating is specified under RATINGS.

CONTACT CONVERTERS

The purpose of the contact converters (CC6, CC7, CC8) included in the Type SLAT54H relay is to convert a contact operation into a signal that is compatible with the logic signal when the external contact is closed; a +15 VDC signal is produced by the contact converter.

CC6 energizes the three pole trip bus.

The functions of CC7 and CC8 depend upon the scheme in which the relay is employed.

PHASE VOLTAGE LEVEL DETECTORS

Three single phase undervoltage detectors are provided.

TARGETS

Four electromechanical target coils are included, one in series with each trip contact. These targets operate on one ampere of trip current when the associated trip contact passes current. The trip circuit resistance in the relay is 0.40 ohm.

LOGIC CIRCUITS

The functions included in the Type SLAT54H relay involve basic logical operations (AND, OR NOT) where the presence or absence of signals, rather than their magnitude, controls the operation. Signals are measured with respect to a reference bus accessible at TP1. In general, a signal below one VDC represents an OFF or LOGIC ZERO condition; an ON or LOGIC ONE condition is represented by a signal of approximately +15VDC.

The symbols used on the internal connection diagram Fig. 1 are explained by the legend shown in Fig. 2.

The matrix blocks shown on the internal connections diagrams of the SLAT54H are connected by jumpers at the factory. These connections are used to implement the logic arrangement shown on the associated overall logic diagram. These matrix jumpers are listed on the associated options chart. A typical option chart for the Type SLA54H relay is shown in Fig. 3. Some of the matrix block connections may be user options. These connections will then be shown as optional connections on the overall logic and must be selected by the user before the unit is placed in service.

CONSTRUCTION

The SLAT54H relay is packaged in an enclosed metal case with hinged front cover and removable top cover. The outline and mounting dimensions of the case and the physical location of the components are shown in Figs. 4 and 5 respectively.

The SLAT54H relay contains printed circuit cards identified by a code number such as: A120, T141 and L102 where A designates an auxiliary function, T designates a time-delay function, and L designates a logical function. The printed circuit cards plug in from the front of the unit. The sockets are marked with letter designations or "addresses" (D.E.F, etc.) which appear on the guide strips in front of each circuit card. The test points (TP1, TP2, etc.) shown on the internal connection diagram are connected to instrument jacks on a test card in position T or AT with TP1 at the top of the AT card. TP1 and TP11 are tied to reference; TP10 and TP20 are tied to  $\pm 15$  VDC through a 1.5K resistor. This resistor limits the current when TP10 or TP20 is used to supply a logic signal to a card.

CAUTION - TP10 AND 20 ONLY SHOULD BE USED TO INJECT ANY SIGNAL TO THE LOGIC CIRCUIT.

The SLAT54H relay receives its inputs from the associated Type SLA relay. These units are interconnected by ten conductor shielded cables. The sockets for these cables are located on the rear panel of the unit. The SLAT54H output functions are connected to 12 point terminal strips, which are also located on the rear of the unit.

A window is provided in the hinged cover of the relay to allow the mechanical targets to be seen. A push button is also provided to reset the electromechanical targets without opening the cover.

Logic options in the SLAT54H relay are selectable by means of jumper wires with taper tip pins on each end which are used to interconnect the matrix block points. These matrix blocks are located in the rear of the unit as shown in Fig. 5. The top cover of the relay must be removed to make the blocks accessible. The taper tip jumpers should be inserted and removed using the special tools which are supplied with each equipment. The green (G), black (B), white (W), violet (V), orange (O), and brown (BR) matrix blocks have 20 individual matrix points. The red (R) block has 20 points which are grouped in 10 pairs. The yellow (Y) block has 20 points which are grouped in two sets of 10 common points; Y1 to Y10 are connected to +15VDC, Y11 to Y20 are connected to reference.

RECEIVING, HANDLING AND STORAGE

This relay will normally be supplied as a part of a static relay equipment, mounted in a rack or cabinet with other static relays and test equipment. Immediately upon receipt of a static relay equipment, it should be unpacked and examined for any damage sustained in transit. If injury or damage resulting from rough handling is evident, file a damage claim at once with the transportation company and promptly notify the nearest General Electric Sales Office.

Reasonable care should be exercised in unpacking the equipment. If the equipment is not to be installed immediately, it should be stored indoors in a location that is free from moisture, dust, metallic chips, and severe atmospheric contaminants.

Just prior to final installation the shipping support bolt should be removed from each side of all relay units, to facilitate possible future unit removal for maintenance. These shipping support bolts are approximately eight inches back from the relay front panel. Static relay equipment, when supplied in a swing rack cabinet, should be securely anchored to the floor or to the shipping pallet to prevent the equipment from tipping over when the swing rack is opened.

### TEST INSTRUCTIONS

If the SLAT54H relay that is to be tested is installed in an equipment which has already been connected to the power system, disconnect the outputs to the system.

#### CAUTION

THE LOGIC SYSTEM SIDE OF THE DC POWER SUPPLY USED WITH MOD III STATIC RELAY EQUIPMENT IS ISOLATED FROM GROUND. IT IS A DESIGN CHARACTERISTIC OF MOST ELECTRONIC INSTRUMENTS THAT ONE OF THE SIGNAL INPUT TERMINALS IS CONNECTED TO THE INSTRUMENT CHASSIS. IF THE INSTRUMENT USED TO TEST THE RELAY EQUIPMENT IS ISOLATED FROM GROUND, ITS CHASSIS MAY HAVE AN ELECTRICAL POTENTIAL WITH RESPECT TO GROUND. THE USE OF A TEST INSTRUMENT WITH A GROUNDED CHASSIS WILL NOT AFFECT THE TESTING OF THE EQUIPMENT. A SECOND GROUND CONNECTION TO THE EQUIPMENT, SUCH AS A TEST LEAD INADVERTENTLY DROPPING AGAINST THE RELAY CASE, MAY CAUSE DAMAGE TO THE LOGIC CIRCUITRY. NO EXTERNAL TEST EQUIPMENT SHOULD BE LEFT CONNECTED TO THE STATIC RELAYS WHEN THEY ARE IN PROTECTIVE SERVICE, SINCE TEST EQUIPMENT GROUNDING REDUCES THE EFFECTIVENESS OF THE ISOLATION PROVIDED.

#### GENERAL

The SLAT54H relay is supplied from the factory either mounted in a static relay equipment or as a separate unit associated with measuring relays, a Type SSA power supply, and some form of channel equipment. All relay units for a given terminal of static relaying equipment are tested together at the factory, and each unit will have the same summary number stamped on its nameplate.

Timers should be set for the operating and reset times indicated on the associated overall logic diagram. Where a time range is indicated on the overall logic diagram, the timer should be set for the value recommended for that function in the descriptive writeup accompanying the overall logic diagram. Where a setting depends upon conditions encountered on a specific application, this is so stated and the factors influencing the choice of setting are described. The procedure for checking and setting the timers is described in a later section.

#### OPERATIONAL CHECKS

Operation of the SLAT54H unit can be checked by observing the signals at the twenty test points (TP1 to TP20) in the SLAT54H by observing the operation of the associated channel equipment, or by observing the output functions. The test points are located on two test cards in positions T and AT, and are numbered 1 to 20 from top to bottom. TP1 is the reference bus for the logic circuit, TP10 is at +15 VDC. The remaining points are located at various strategic points throughout the logic as shown on the internal connection diagram Fig. 1. Test point voltages can be monitored with a portable high impedance voltmeter, the voltmeter on the test panel of the associated equipment, or an oscilloscope.

Operation of any logic function may be checked by supplying the correct inputs to the card. This is accomplished by placing the card under test in a card extender, removing the cards which normally supply the input signals, and then connecting the card inputs to either TP10 or TP1. An output should be produced when the proper combination of inputs is supplied to the card.

#### TEST CARD ADAPTER

The test card adapter provides a convenient means of gaining access to any pin of a particular card. Detailed information on the use of the test adapter card is included in the card instruction book GEK-34158.

#### TIMER ADJUSTMENTS AND TESTS

When the time-delay cards are to be adjusted or checked, an oscilloscope that can display two traces simultaneously and that has a calibrated horizontal sweep should be used.

In order to test the timer cards it is necessary to remove the card which supplied the input to the timer and to place the timer card in a card adapter. The card adapter allows access to the input and output of the timer if they are not brought out on test points. The timer test circuit is shown on Fig. 6.

Opening the normally closed contact causes the output to step up to +15 VDC after the pickup delay of the timer. To increase the pickup time, turn the upper potentiometer on the timer card clockwise; to decrease the time turn it counterclockwise. Closing the contact causes the timer output to drop out after the reset time-delay setting of the card. If the timer card is provided with a variable reset delay, it can be adjusted by the lower potentiometer on the timer card (clockwise increases reset time).

### TRIP CIRCUIT TESTS

The trip circuits and series mechanical targets may be checked by connecting an auxiliary lockout relay, such as the Type HEA relay, in series with each trip circuit. If an auxiliary lockout relay is not available, it can be replaced by a resistive load which limits the trip circuit current to three amperes. In most equipments, the trip circuits may be activated by operating a test push button in the associated units.

Prior to final installation, a check of the overall trip circuit should be made with the trip outputs connected to trip the circuit breakers.

### PHASE UNDERVOLTAGE DETECTORS

The operation of the phase undervoltage detectors may be checked using the test circuit of Fig. 7.

Use the following test procedure.

- 1) Set the applied voltage for 40 VRMS. Use connections of Table 1 and check for +15 VDC output.
- 2) Set the applied voltage for 15 VRMS. Use the connections of Table 1 and check for less than 1 VDC output.

TABLE 1

	A	B	OUTPUT
ØA	AL10	AM10	W 7
ØB	AL11	AM11	W 9
ØC	AL12	AM12	W 11

### OVERALL EQUIPMENT TESTS

After the SLAT54H relay and the associated static relay units have been individually calibrated and tested for the desired settings, a series of overall operating circuit checks is advisable.

The elementary, overall logic, and logic description for the specific job will be useful for determining the overall operation of the scheme.

Overall equipment tests can be performed by applying AC current and voltages to the measuring units as specified in the instruction book for the measuring units and checking that proper outputs are obtained when the measuring units operate.

## MAINTENANCE

### PERIODIC TESTS

It should be sufficient to check the outputs produced at test points in the SLAT54H where periodic calibration tests are made on the associated measuring units, for example, the phase and ground relays in line relaying scheme. No separate periodic tests on the SLAT54H itself should be required.

### TROUBLESHOOTING

In any troubleshooting of equipment, it should first be established which unit is functioning incorrectly. The overall logic diagram supplied with the equipment shows the combined logic of the complete equipment and the various test points in each unit. By signal tracing, using the overall logic diagram and the various test points, it should be possible to quickly isolate the trouble.

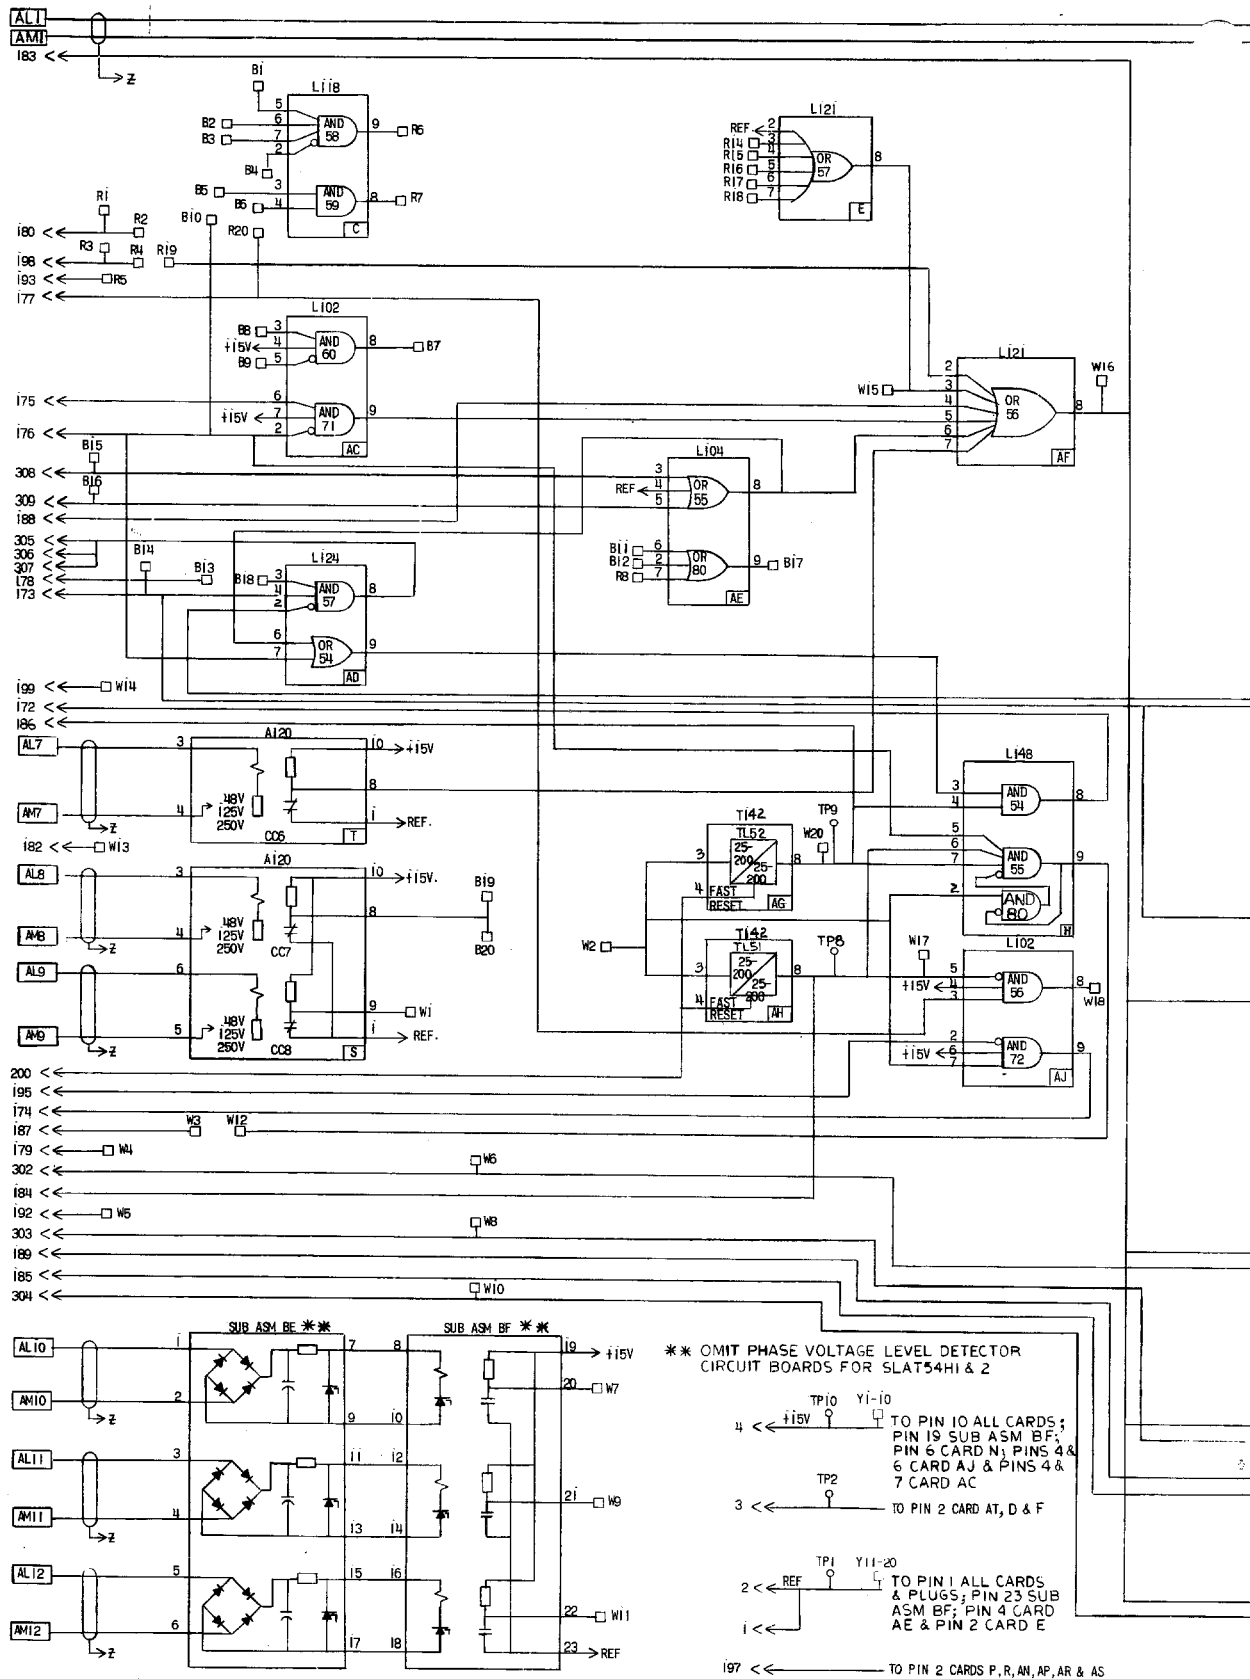


FIG. 1 (0136D3520-0) INTERNAL CONNE















NOTES:

- FOR MATRIX CONNECTIONS SUPPLIED ON A PARTICULAR EQUIPMENT, REFER TO THE OVERALL WIRING DIAGRAM
- "R" REPRESENTS RED MATRIX BLOCK  
 "Y" " " YELLOW " "  
 "G" " " GREEN " "  
 "W" " " WHITE " "  
 "B" " " BLACK " "
- DLA LEADS 412-416 ARE SINGLE LEAD.  
 DLA LEADS 417-419 ARE DOUBLE LEADS.

COMPONENT VALUE	
R1, R3	50Ω, 20W -48VDC 850Ω, 17W -125VDC
R2, R4	200Ω, 17W -48VDC 1.7K, 17W -125VDC
D1, D2	1N5061, 1AMP, 600V

* OPTION CARDS		
SLATS54H	AN	AP
1	A108	A108
2	A108	A108

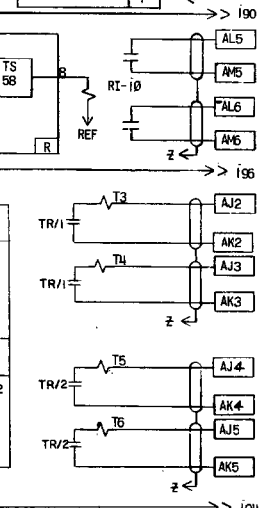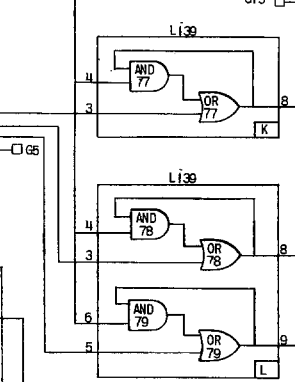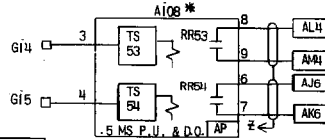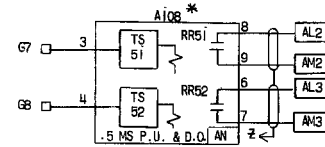

(TO SURGE GRD) z ←

A test adapter card is supplied with each static relay equipment to supplement the prewired test points on the test cards. Use of the adapter card is described in the card instruction book GEK-34158.

A dual-trace oscilloscope is a valuable aid to detailed troubleshooting, since it can be used to determine phase shift, operate and reset times as well as input and output levels. A portable dual-trace oscilloscope with a calibrated sweep and trigger facility is recommended.

#### SPARE PARTS

To minimize possible outage time, it is recommended that a complete maintenance program should include the stocking of at least one spare card of each type. It is possible to replace damaged or defective components on the printed circuit cards, but great care should be taken in soldering so as not to damage or bridge-over the printed circuit busses, or overheat the semi-conductor components. The repaired area should be recovered with a suitable high-dielectric plastic coating to prevent possible breakdowns across the printed busses due to moisture and dust. The wiring diagrams for the cards in the SLAT54H relay are included in the card book GEK-34158.

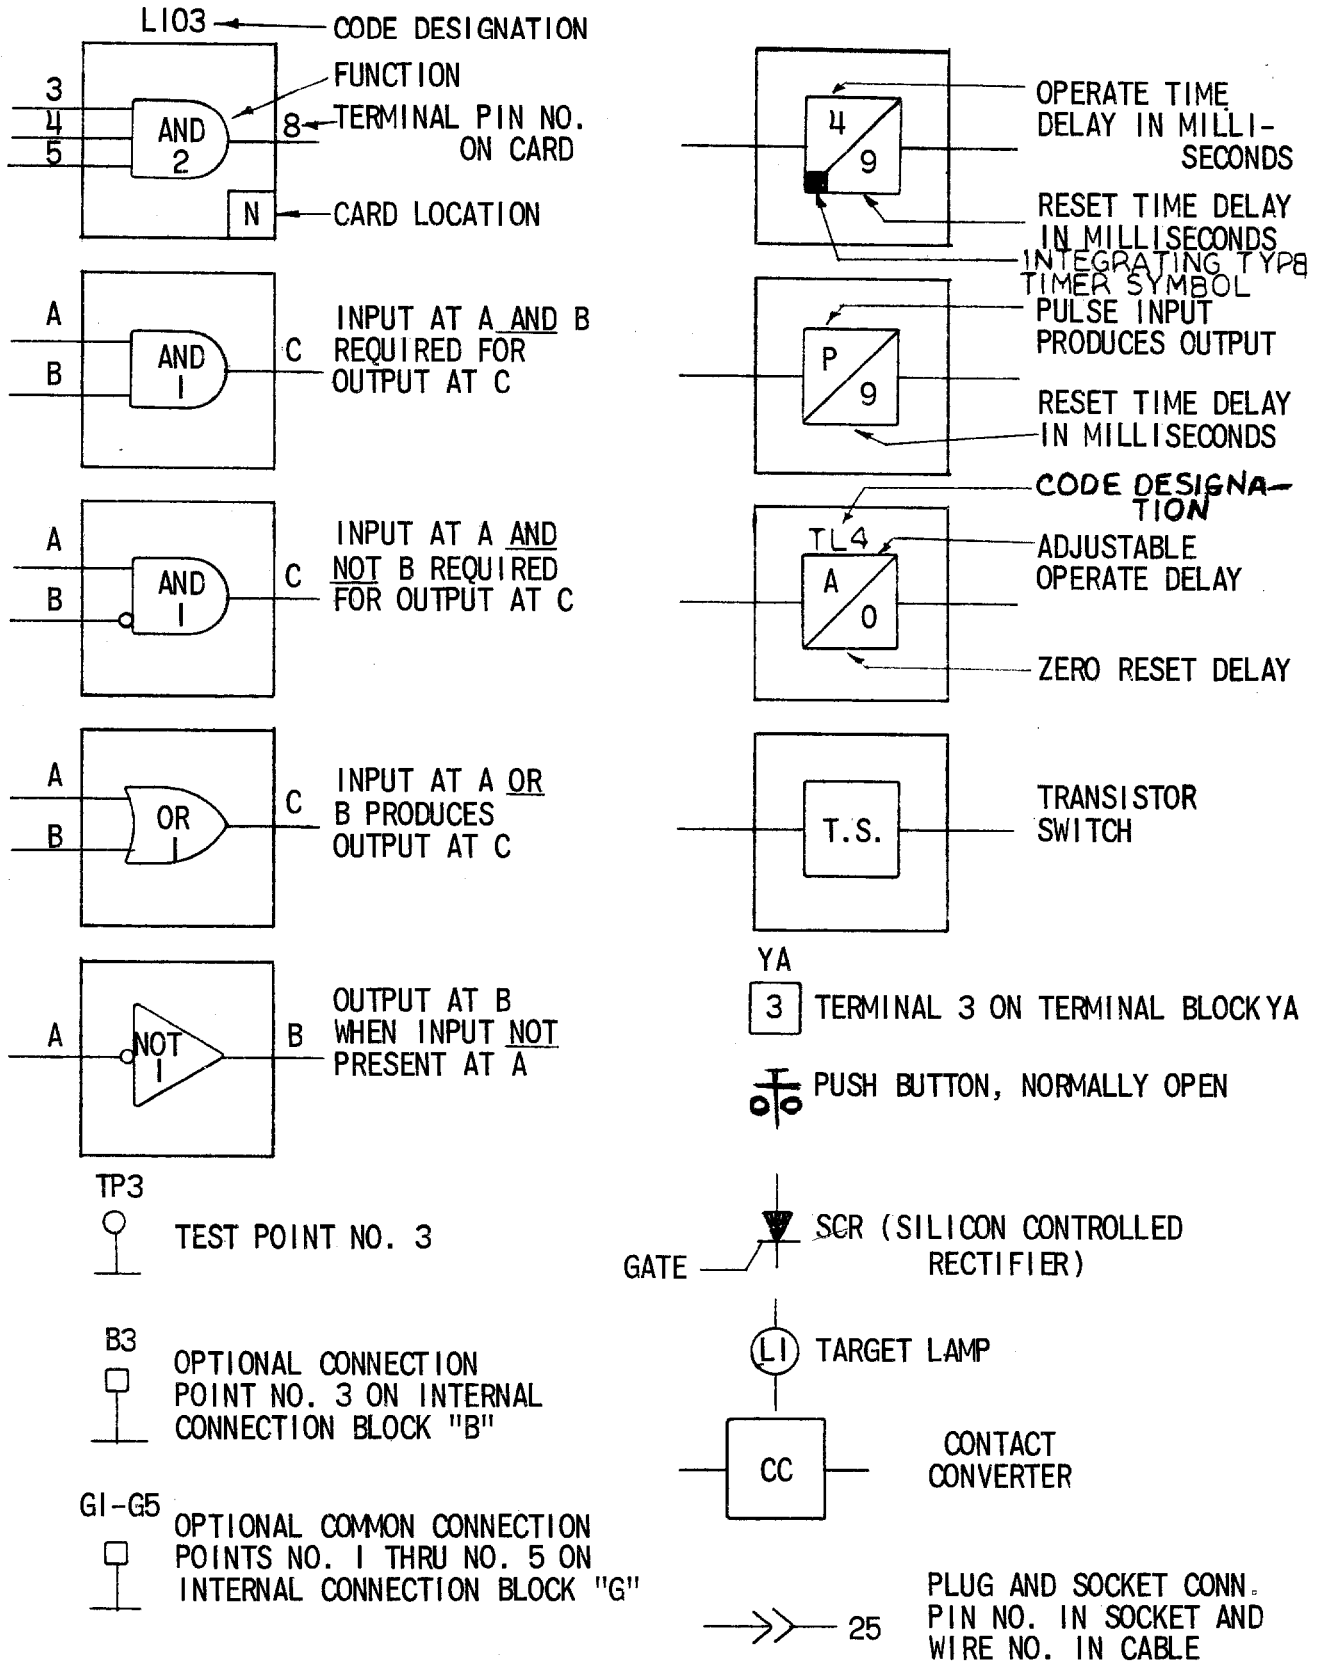


FIG. 2 (0227A2047-1) INTERNAL CONNECTION DIAGRAM LEGEND

THE FOLLOWING ARE FACTORY CONNECTIONS MADE AT THE MATRIX BLOCKS INSIDE OF THE SLA RELAY ASSOCIATED WITH THIS EQUIPMENT. SYMBOLS LISTED: PL=RELAY INTERCONNECTING CABLE LEAD (5)=LOGIC FUNCTION CARD PIN NUMBER ±=3-WAY CONNECTION \* =DLA MONITOR CONNECTION AVAILABLE BUT NOT USED

123

Table with 4 columns: MATRIX BLOCK JUMPERS (FROM, TO), LOGIC FUNCTION (FROM, TO). It lists factory connections between matrix blocks and logic functions, such as G17 to Y11 connecting to OR51 AK4 REF.

FIG. 3 (0227A2050-1 Sh. 123) TYPICAL OPTION CHART FOR THE SLAT54H RELAY

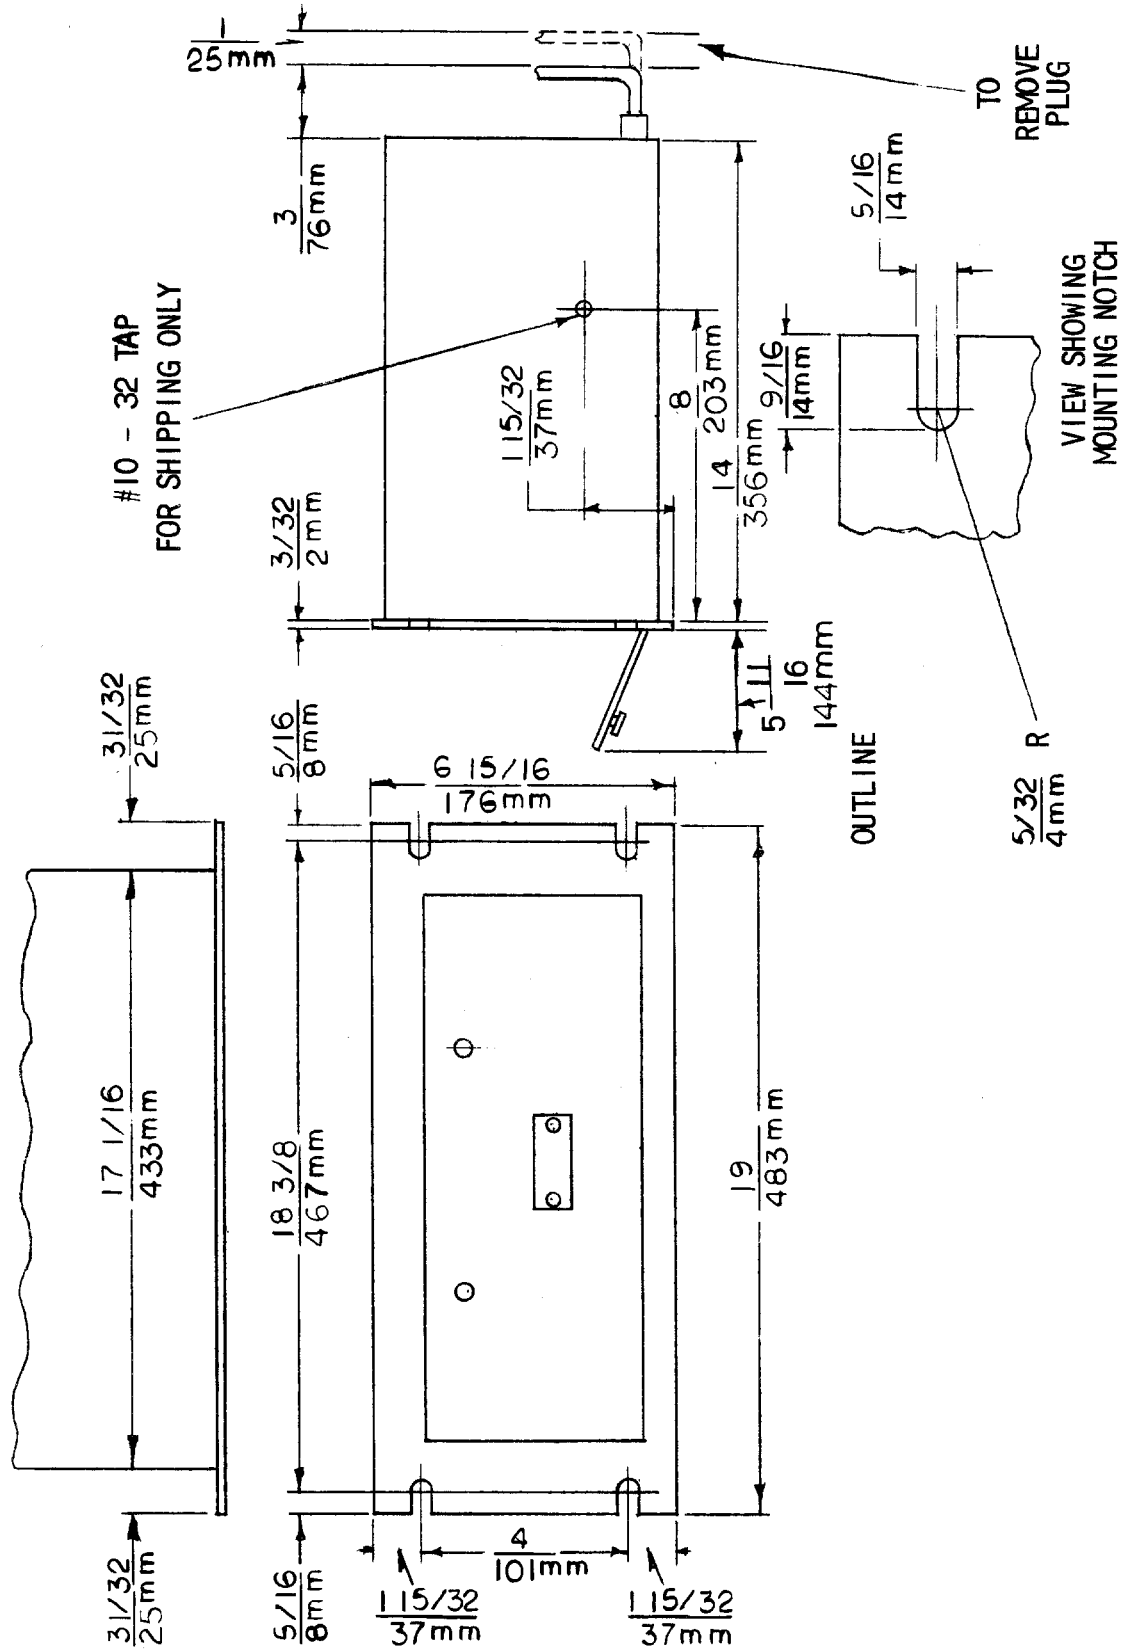


FIG. 4 (0227A2037-1) OUTLINE AND MOUNTING DIMENSIONS FOR SLAT54H RELAY




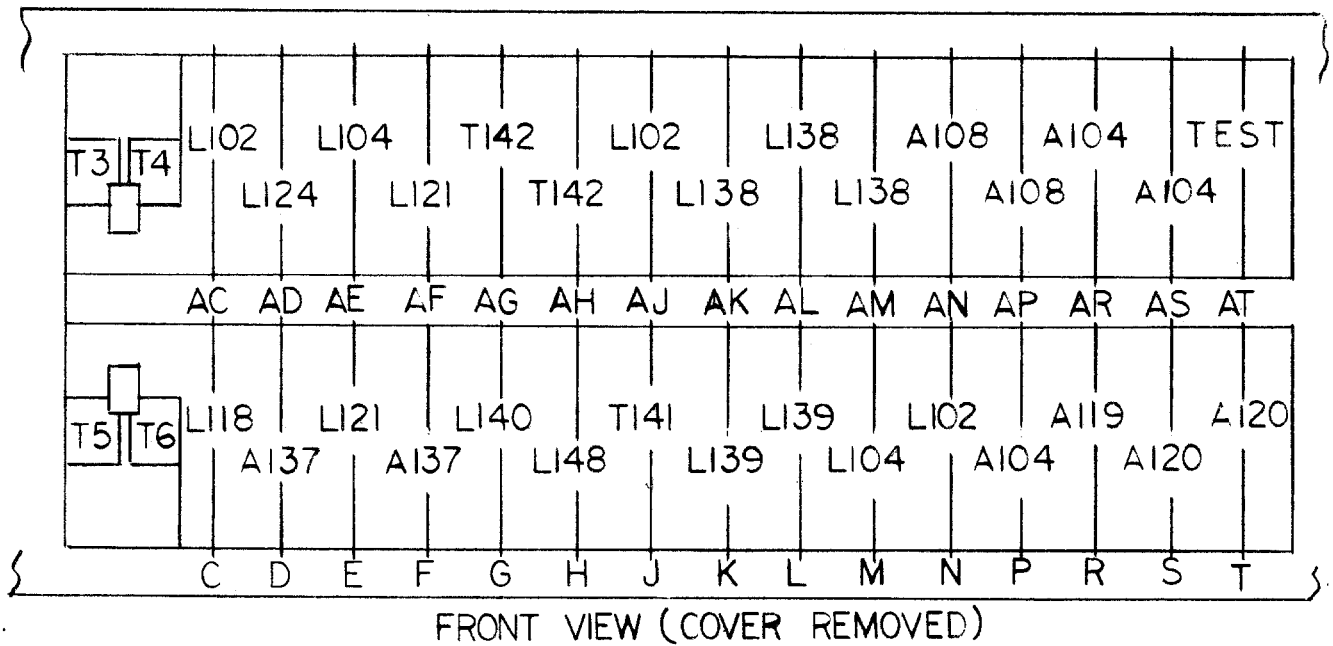


FIG. 5 (0269A3128-0) COMPONENT LOCATION DIAGRAM FOR THE SLAT54H RELAY

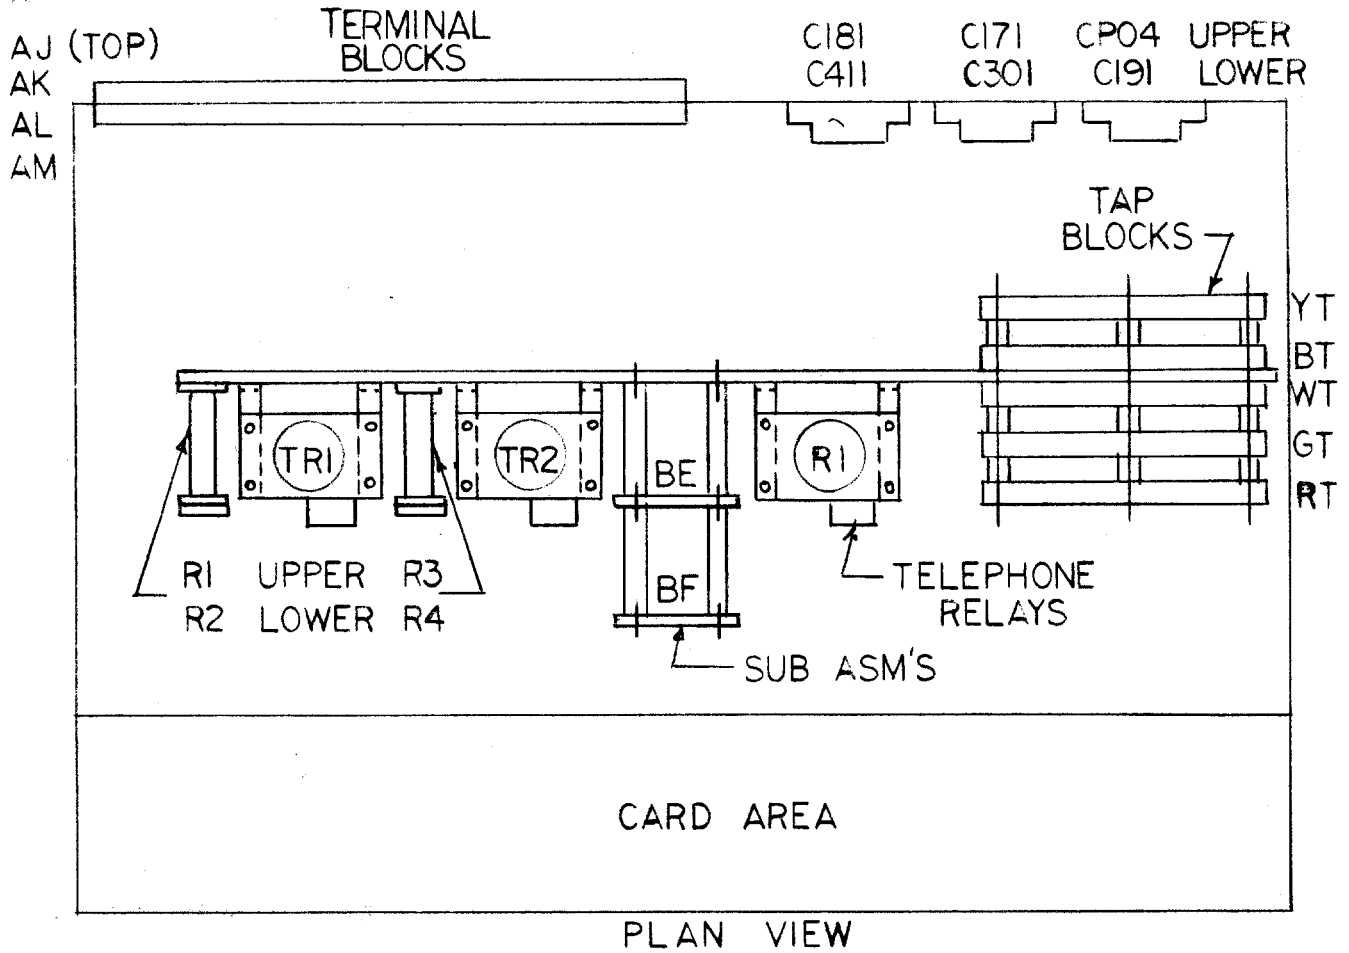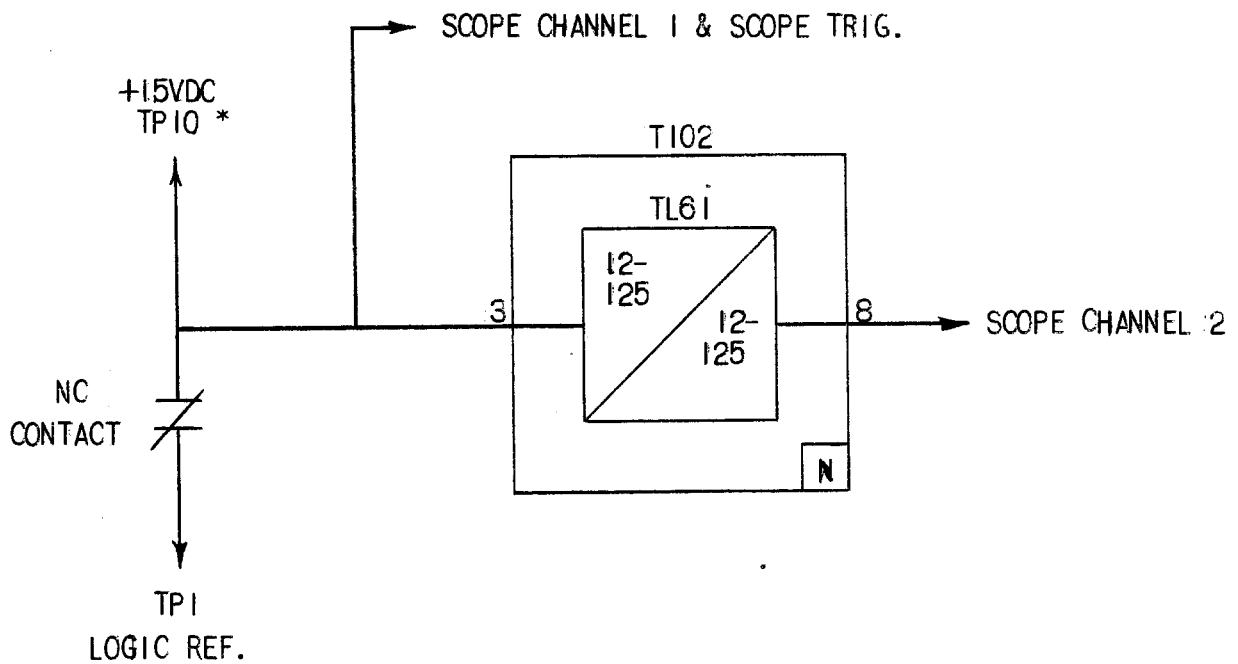

\* THE 15VDC SIGNAL AT PIN 10 HAS A CURRENT LIMITING RESISTOR MOUNTED ON THE TEST CARD.

FIG. 6 (0246A7987-0) LOGIC TIMER TEST CIRCUIT

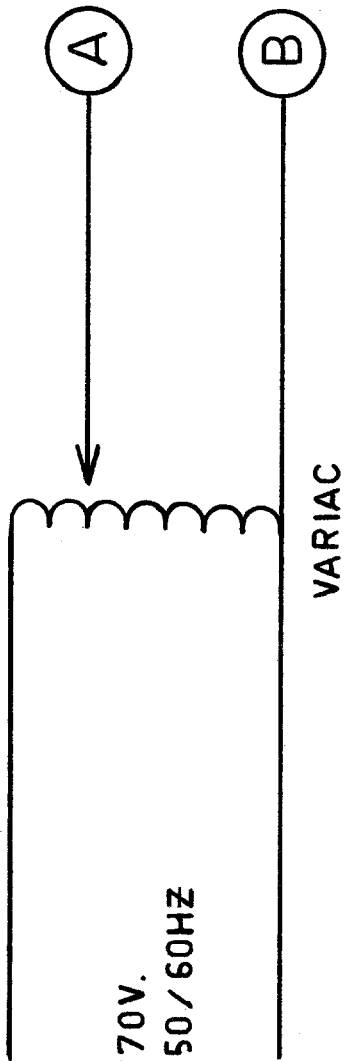

PHASE UNDER TEST	CONNECTIONS		MEASURE OUTPUT
	A	B	
A	AL10	AM10	W 7 *
B	AL11	AM11	W 9 *
C	AL12	AM12	W 11 *

\* USE OPTION CHART TO DETERMINE TO WHICH CARD INPUTS THESE MATRIX POINTS ARE CONNECTED. OUTPUT MAY BE MEASURED AT CARD INPUT PIN.

+ LOCATED ON REAR OF SLAT 54B UNIT.

FIG. 7 (0257A8704-0) PHASE VOLTAGE LEVEL DETECTOR CIRCUIT