

INSTRUCTIONS

GEK-65682
Insert Booklet GEK-65533

STATIC AUXILIARY TRIPPING RELAY

TYPE SLAT52F

INTRODUCTION

This supplement in addition to GEK-65533 constitutes the instructions for the SLAT52F auxiliary tripping relay.

DESCRIPTION


This SLAT52F is similar to the SLAT52C except that the negative bias for the relay driver card for RI and BFI is supplied externally. This permits the operation of these functions to be supervised by a contact converter which is located in another tripping unit.

The internal connections for the SLAT52F are shown in Fig. 1 of this book.

These instructions do not purport to cover all details or variations in equipment nor to provide for every possible contingency to be met in connection with installation, operation or maintenance. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to the General Electric Company.

To the extent required the products described herein meet applicable ANSI, IEEE and NEMA standards; but no such assurance is given with respect to local codes and ordinances because they vary greatly.

GEK-65682

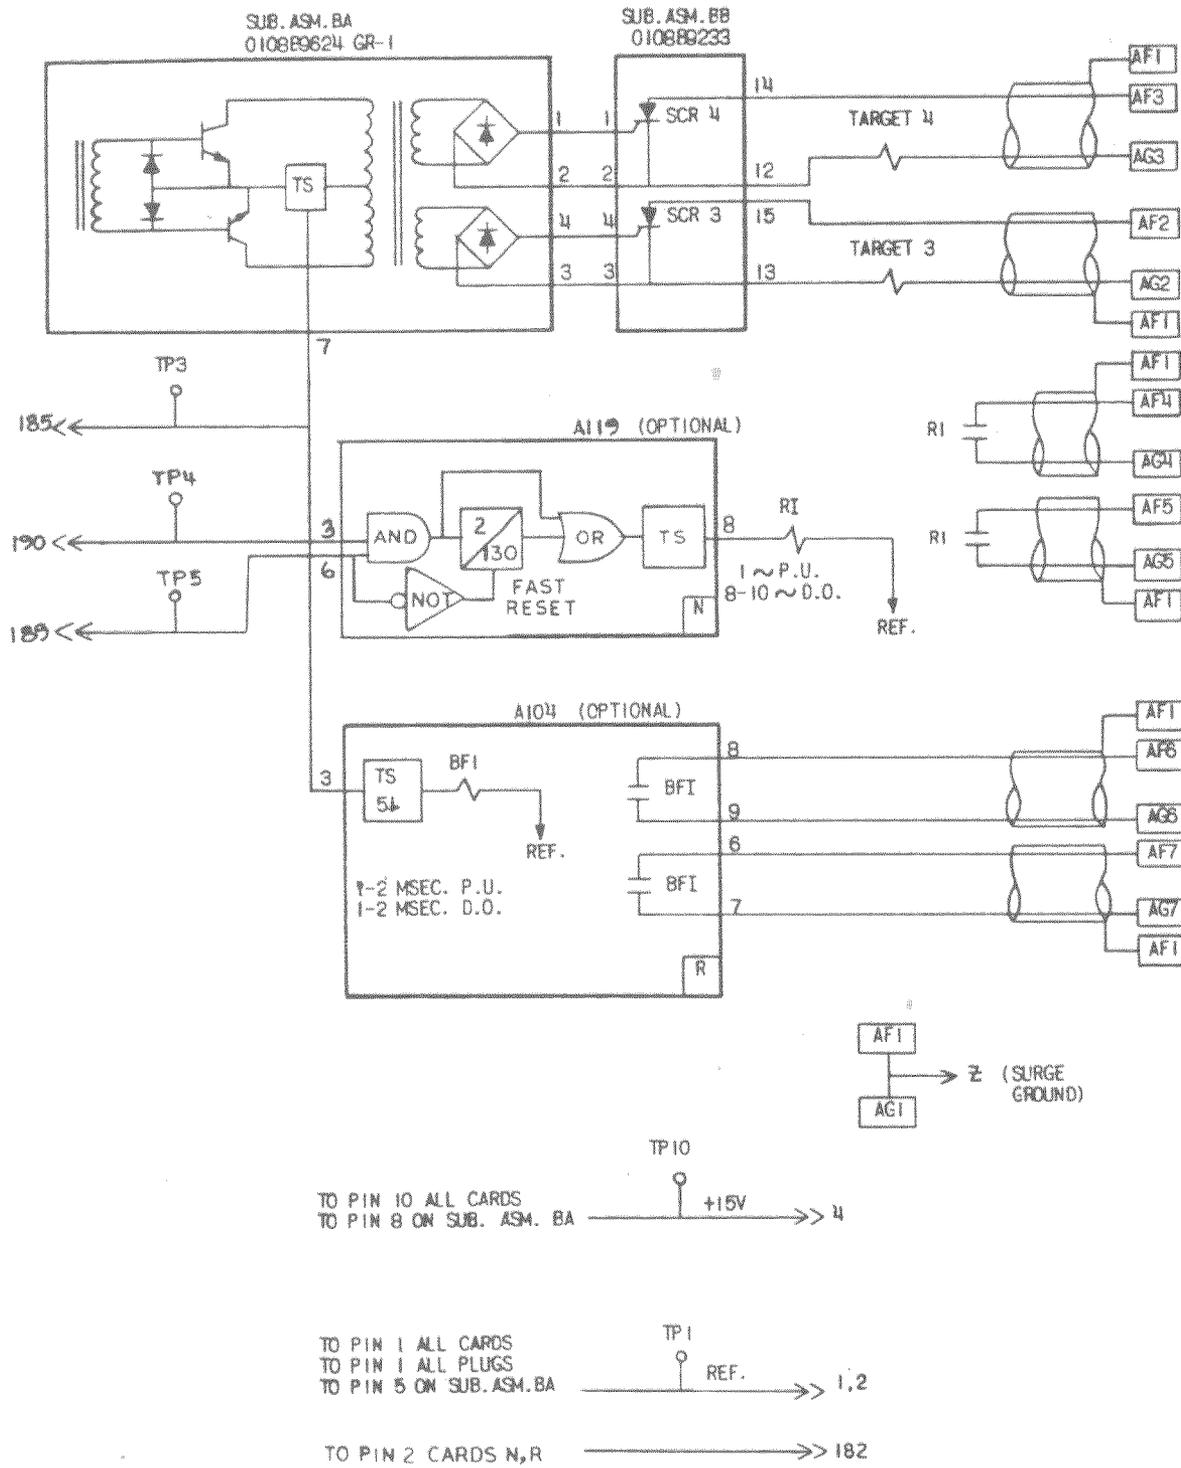

SLAT52F(-)

FORM	1	2	3	4	5	6	7	8
TRIP VOLTAGE	48/125	48/125						
2 SCR'S	X	X						
2 BFI		A104						
2 RI		A119						

Fig. 1 (0165B2488-0) Internal Connections for the SLAT52F Relay