



TOL	+/-
A	.06
B	.12
C	.18
D	.25
E	.04

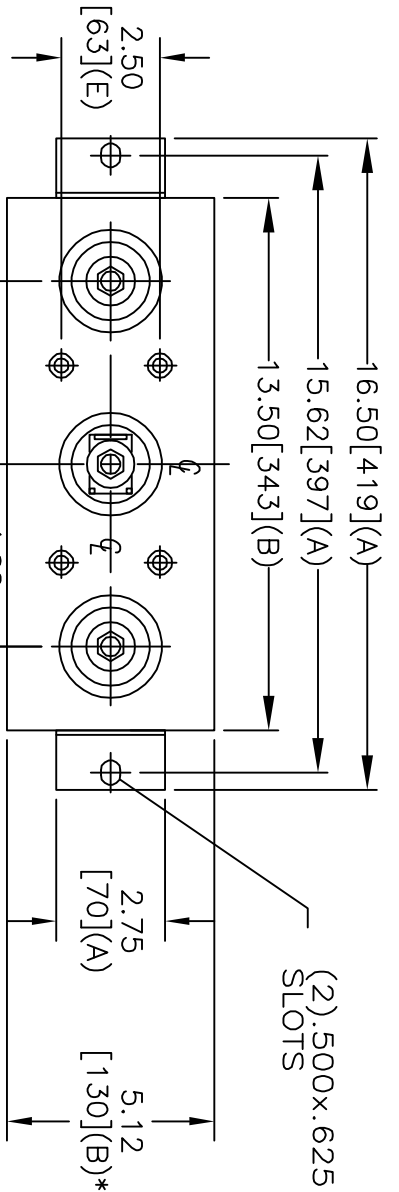

(4) .38-16 THD. MOUNTING STUDS. .500-13 THD. SOLDERLESS CONN. FOR #10 SOLID TO #2 STRANDED.

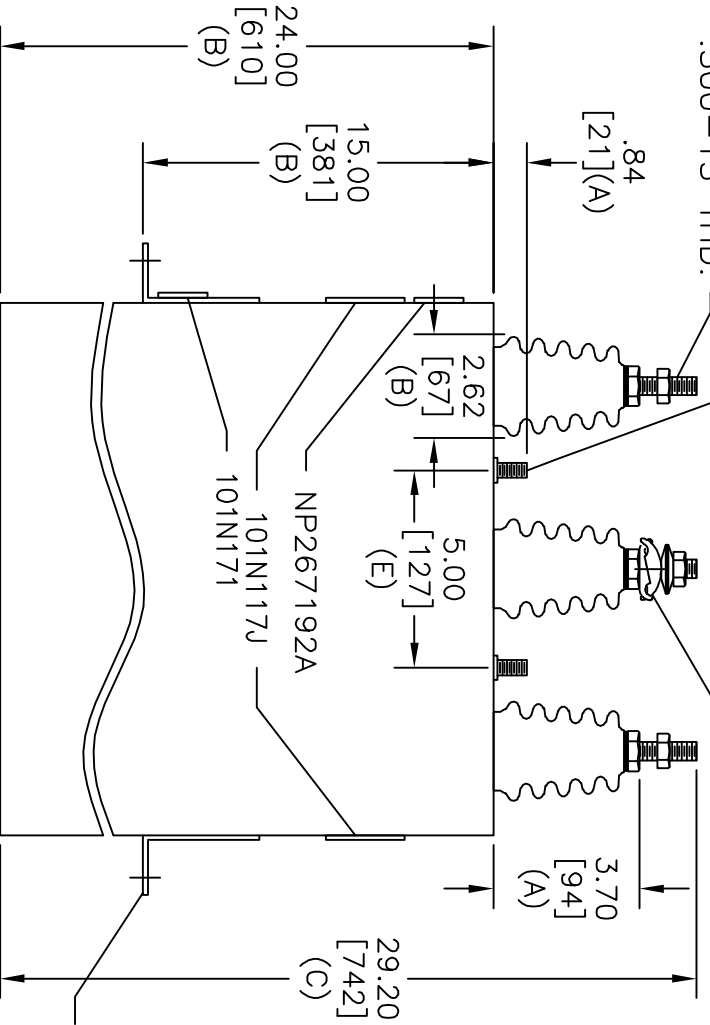


UNPAINTED AREA UNDER BOTH BRACKETS FOR GROUNDING

* UP TO +.50 [13] CASE BULGE

MAX. TERMINAL TIGHTENING TORQUE 15 FT-LBS

NP267192A

SIZE	DWG NO	SHT	REV
A	16L0345WH3	2	
REV	DESCRIPTION	DATE	APPROVED

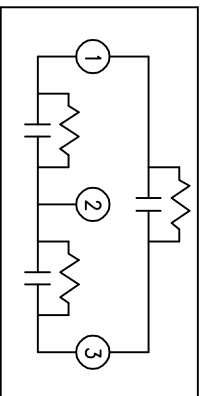

SCHEMATIC DIAGRAM - 302

3300V	3PH	60 KVBL
300	KVAR	60 Hz
CAT	16L0345WH3	SN
	2.2 GAL.	
101N171	MFG DATE	READ GEH-2743

GE ENERGY FORT EDWARD, N.Y., U.S.A.

DRAWN B. ROSS DATE JAN 3, 2006

ISSUED DATE 1/4/05

SIZE A SCALE

OUTLINE 16L0345WH3

SHEET 2 CONT ON 3