


TOL	+/-
A	.06
B	.12
C	.18
D	.25
E	.03

SIZE A	DWG NO 16L0374WH4	SHT 2	REV A
REV A	DESCRIPTION BUSHING WAS 3 FLUTE	DATE 10/13/2009	APPROVED BTR


TERM	uF	kVAR
1	350.8	360
2	116.9	120

* UP TO +.50
CASE BULGE

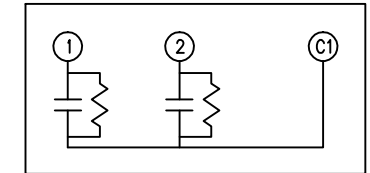

SCHEMATIC DIAGRAM - 212

360-120 KVAR SECTION
 1650V 1 PH kVBIL
 480 KVAR 60 Hz
 CAT 16L0374WH4 SN
 4.3 GAL.
 MFG DATE
 101N171 READ GEH- 2743

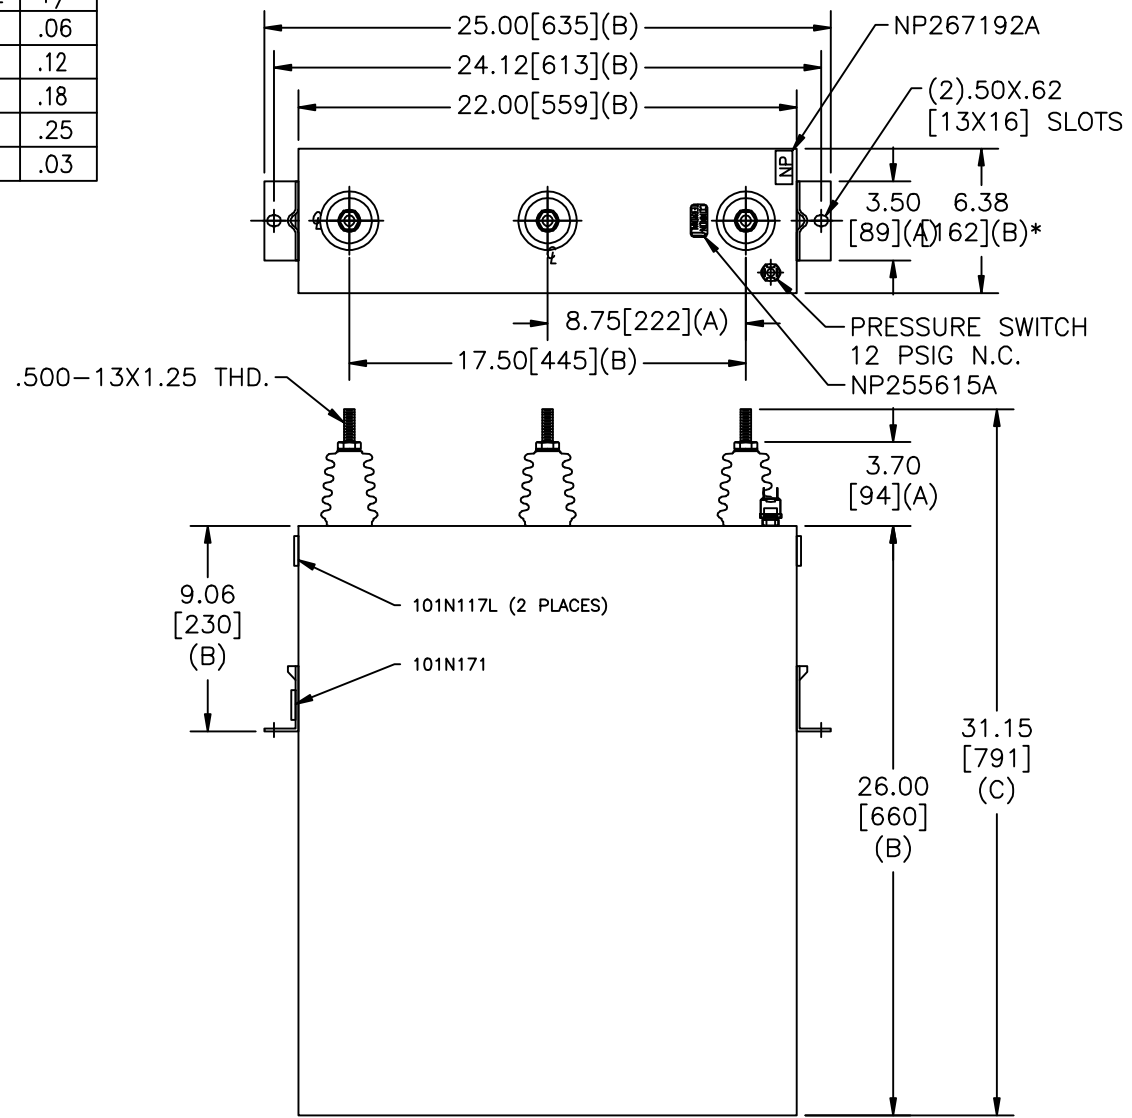

MAX. TERMINAL
TIGHTENING TORQUE
15 FT-LBS
NP267192A

GE ENERGY FORT EDWARD, N.Y., U.S.A.	SIZE A	<h1>OUTLINE</h1> <h2>16L0374WH4</h2>
	SCALE	
DRAWN B.Ross ISSUED	DATE 10/7/2009 DATE 12/2/2009	SHEET 2 CONT ON 3

DISTR. TO