




TOL	+/-	BUSH. DIA.
A	.06	1.75[44](B)
B	.12	
C	.18	
D	.50	
E	.04	

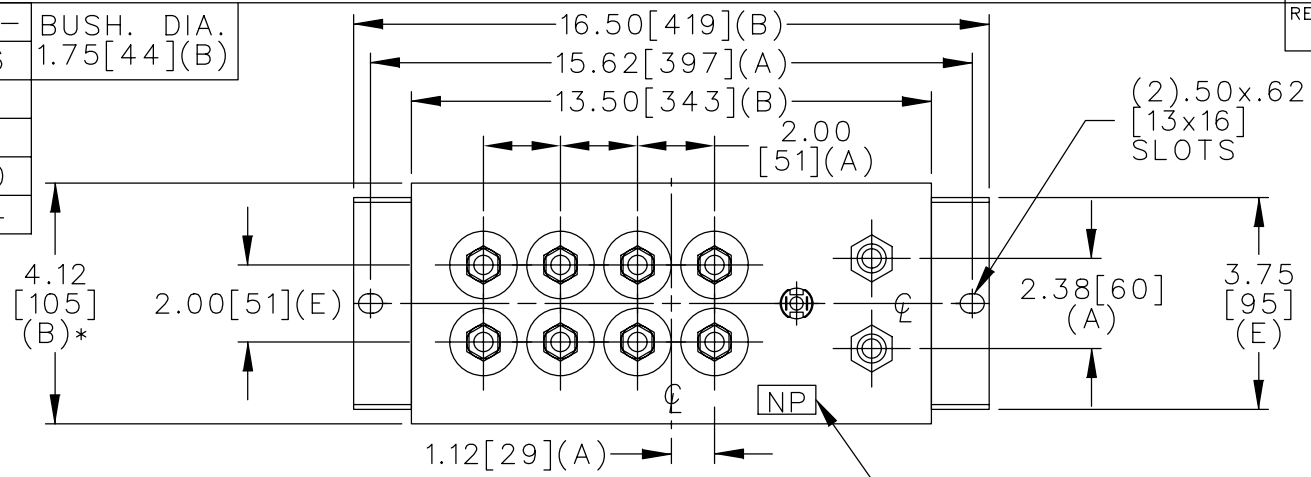

TERM	uF	kVAR
1	4.58	194
2	4.58	194
3	4.58	194
4	4.58	194
5	9.17	389
6	9.17	389
7	9.17	389
8	9.17	389

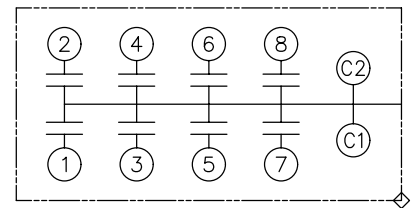

SCHEMATIC DIAGRAM - 801

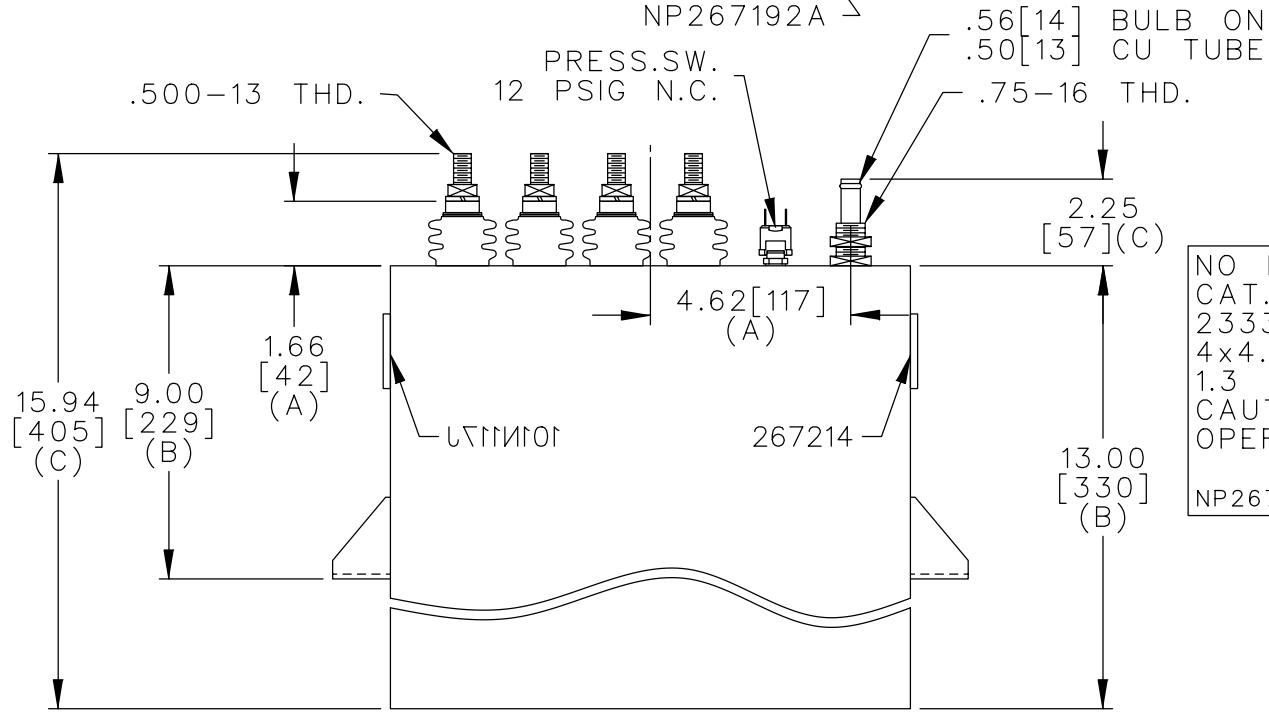

NO INTERNAL DISCHARGE RESISTORS  
 CAT. 19L0104WH4 SN  
 2333KVAR 1500V 3000HZ 1PH  
 4x4.58+4x9.17 UF/TAP  
 1.3 GALS. COMBUSTIBLE LIQUID  
 CAUTION! BEFORE INSTALLING OR  
 OPERATING READ GEH-2733  
 NP267214

\* UP TO +.50[13]  
CASE BULGE

MAX. TERMINAL  
TIGHTENING TORQUE  
15 FT-LBS

NP267192A

	CAPACITOR & POWER PROTECTION FORT EDWARD, N.Y., U.S.A.		SIZE <b>A</b>	<h1>OUTLINE</h1> <h2>19L0104WH4</h2>	
	DRAWN P.COLE	AUG. 26, 1997	SCALE		
ISSUED	8-27-97	SHEET 2	CONT. ON	DISTR TO	