



TOL	+/-
A	.06
B	.12
C	.18
D	.25
E	.03

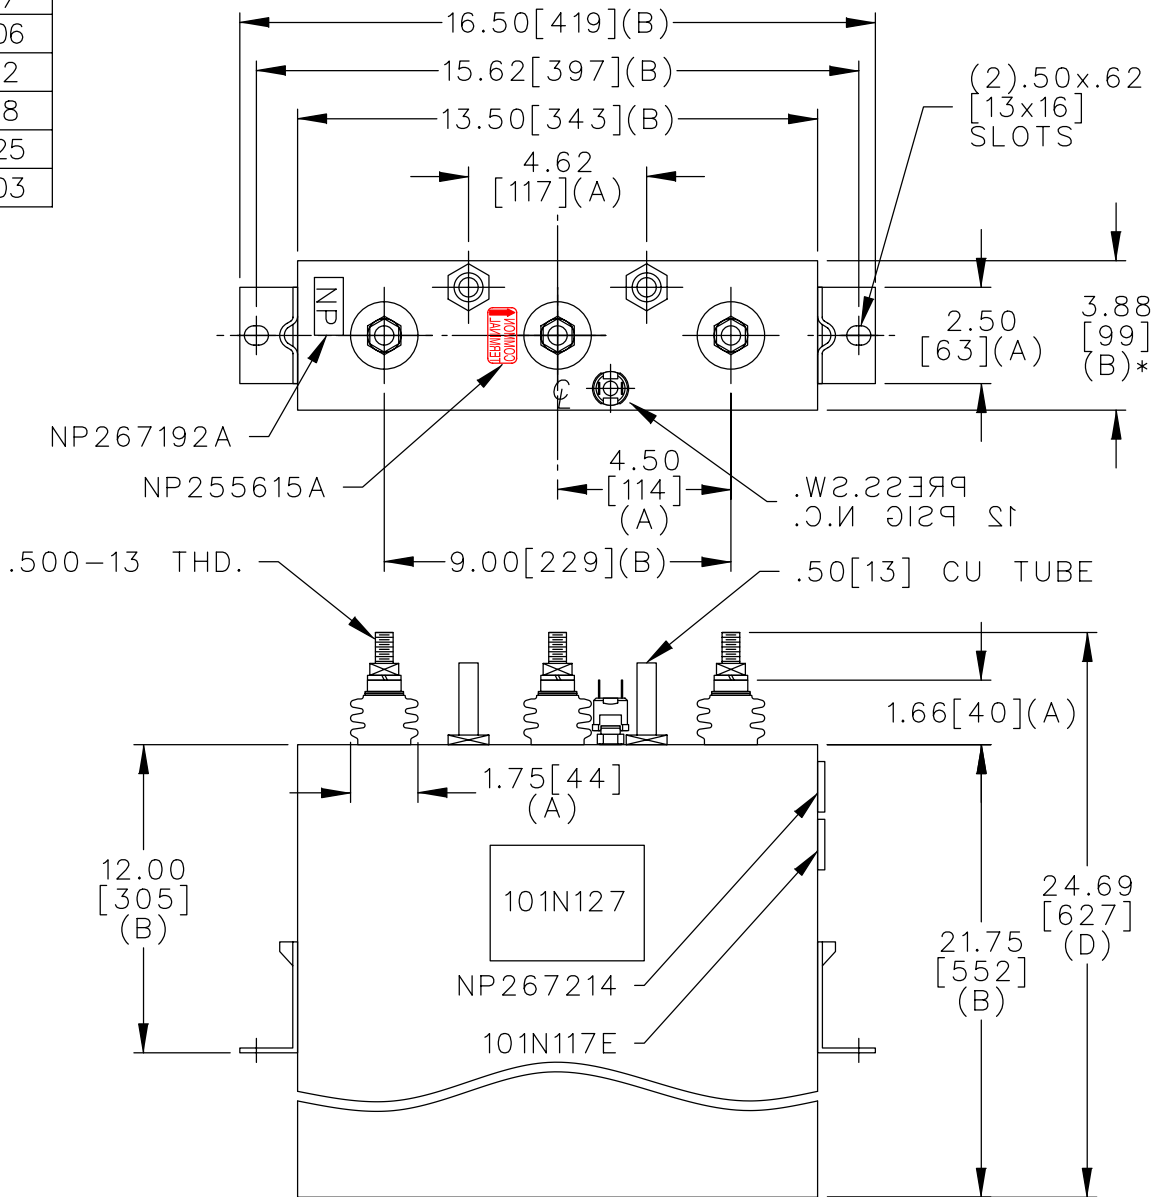

SIZE A	DWG NO. 19L0821TH4	SH 2	REV
REV 2	9-25-96		
3	BROSS UPDATE BORDER		

TERM	uF	kVAR
1	368.4	50
2	368.4	50

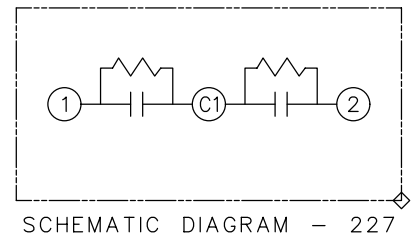

WITH INTERNAL DISCH RESISTORS
 CAT. 19L0821TH4 SN
 100KVAR 600V 60HZ
 2 x 368.4 UF/TAP
 2.33 GAL COMBUSTIBLE LIQUID
 CAUTION! BEFORE INSTALLING OR
 OPERATING READ GEH2733+2739
 NP267214

* UP TO +.50 [13]
 CASE BULGE

MAX. TERMINAL
 TIGHTENING TORQUE
 15 FT-LBS

NP267192A

	CAPACITOR & POWER PROTECTION FORT EDWARD, N.Y., U.S.A.		SIZE A	FSCM NO	OUTLINE 19L0821TH4	DISTR TO
	DRAWN W.DeGROFF	JUNE 4, 1991	SCALE	SHEET 2		
ISSUED	6-6-91					