



TOL	+/-	BUSH. DIA.
A	.06	1.75[.44](B)
B	.12	
C	.18	
D	.25	
E	.04	

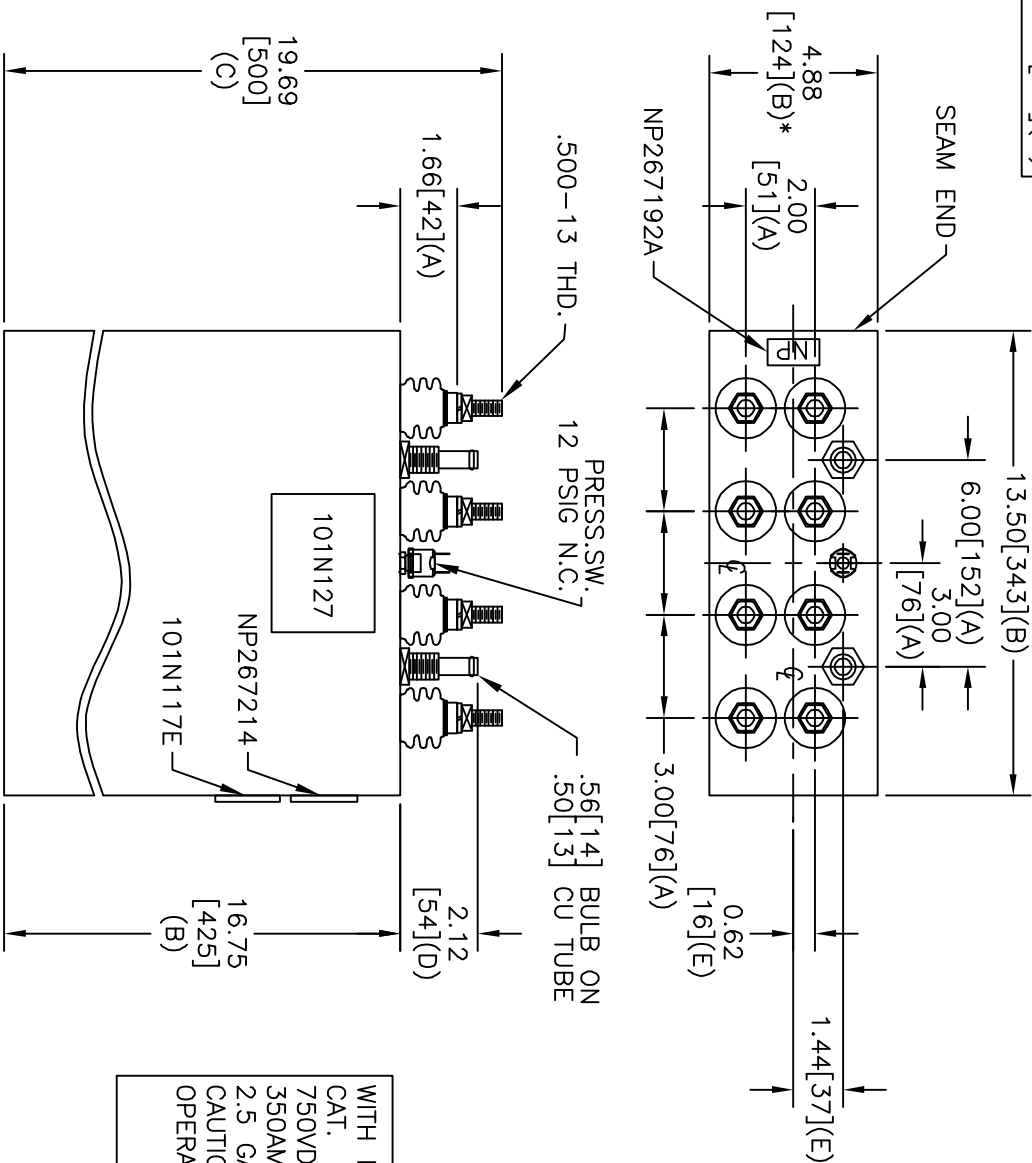

SIZE	DWG NO	SHT	REV
A	19L0882TH2	2	2
REV	DESCRIPTION	DATE	APPROVED
2	CHANGE NAMEPLATE	12/18/2006	BTR

TERM	UF
1	750
2	750

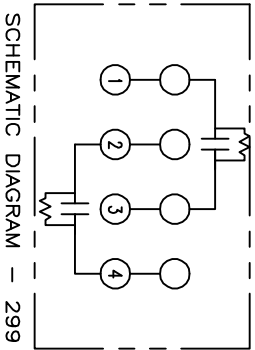

WITH INTERNAL DISCH RESISTORS
 CAT. 19L0882RH2 SN
 750VDC 750/750UF
 350AMP RMS/SECT 1-3KHZ
 2.5 GAL. COMBUSTIBLE LIQUID
 CAUTION! BEFORE INSTALLING OR
 OPERATING READ GEH-2733
 NP267214

* UP TO +.50[13]
 CASE BULGE

MAX. TERMINAL
 TIGHTENING TORQUE
 15 FT-LBS
 NP267192A

GE ENERGY
FORT EDWARD, N.Y., U.S.A.

DRAWN E. McGinn
 DATE 3/1/1996

ISSUED DATE 3/6/1996

SIZE **A**

SCALE

OUTLINE

19L0882TH2

SHEET 2 CONT 3

DISTR. TO