



57 kV MCOV

SIZE A	DWG NO 911XPE072AS	SHT 1	REV
REV	DESCRIPTION	DATE	APPROVED

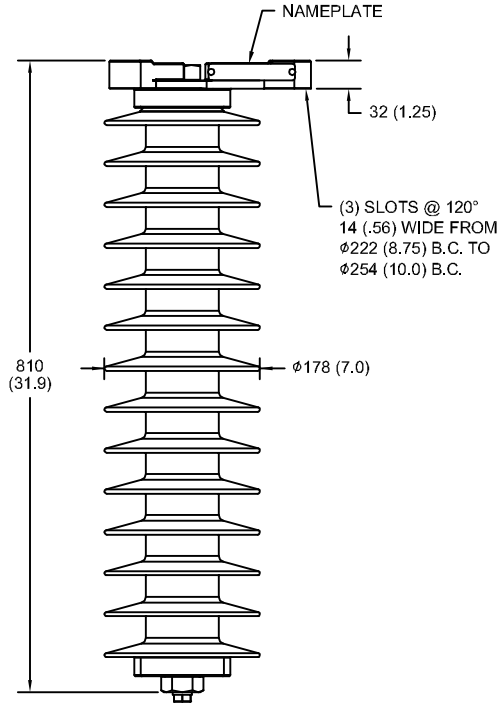


LINE TERMINAL DETAIL

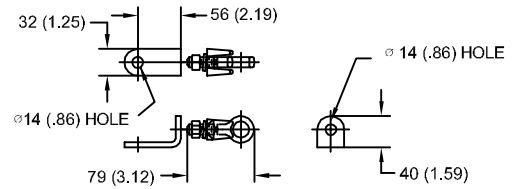

HDG TERMINAL BRACKET
ONE HDG TERMINAL
SUITABLE FOR CU OR AL CONDUCTOR SIZE
Ø 7 (.25) - Ø 21 (.81) DIA
25 - 240 sq mm
AWG#4 - 500 MCM

GROUND TERMINAL DETAIL

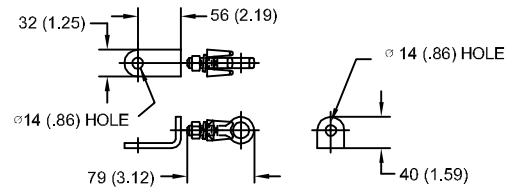

HDG TERMINAL BRACKET
ONE HDG TERMINAL
SUITABLE FOR CU OR AL CONDUCTOR SIZE
Ø 7 (.25) - Ø 21 (.81) DIA
25 - 240 sq mm
AWG#4 - 500 MCM

CHARACTERISTICS

RATED VOLTAGE	72 kVrms
MCOV	57 kVrms
MASS	18.6 kg (41.1 lb)
COG ABOVE BASE	406 (16.0)
CREEPAGE DISTANCE	2093 (82.4)
STRIKE DISTANCE	734 (28.9)
LIGHTNING IMP W/S	421 kVpk
SWITCHING IMP WET W/S	353 kVpk
POWER FREQ WET W/S	194 kVrms
TOV 1s NO PRIOR DUTY	82.8 kVrms
TOV 10s NO PRIOR DUTY	79.3 kVrms
TOV 1s W/PRIOR DUTY	80.2 kVrms
TOV 10s W/PRIOR DUTY	77.0 kVrms

CANTILEVER FORCE

MAXIMUM CONTINUOUS	1265 N (284 lbs)
ULTIMATE (max pk)	2531 N (569 lbs)

RECOMMENDED CLEARANCE (CENTER - CENTER)

PHASE TO GROUND	488 (19.2)
PHASE TO PHASE	645 (25.4)

- NOTES:
1. DIMENSIONS IN millimeters(inches) SUBJECT TO ±3% TOLERANCE
2. CLEARANCE AND INSULATION W/S VOLTAGE APPLY AT SEA LEVEL
3. ARRESTER SUITABLE FOR OPERATION AT ALTITUDES UP TO 1800 m (6000 ft)
4. PACKAGED IN A CORRUGATED BOX.

.5µSEC 10kA IR kV	SWITCHING SURGE IR kV		MAXIMUM 8/20 DISCHARGE VOLTAGE - kV AT					
	500 A	1 KA	1.5 kA	3.0 kA	5 kA	10 kA	20 kA	40 kA
192	137	143	147	154	161	173	187	214



GE ENERGY
FORT EDWARD, N.Y., U.S.A.

SIZE

A

ANSI

STATION CLASS

ARRESTER
9L11XPE072AS

DRAWN JBC DATE 5/03/2011

ISSUED DATE 5/03/2011

SCALE

SHEET 1 CONT ON -

DISTR. TO