


SIZE A	DWG NO 9L20BXX0**XHS	SHT 1	REV
REV	DESCRIPTION	DATE	APPROVED

NOTES:
1. DIMENSIONS SUBJECT TO +/- 3% TOLERANCE

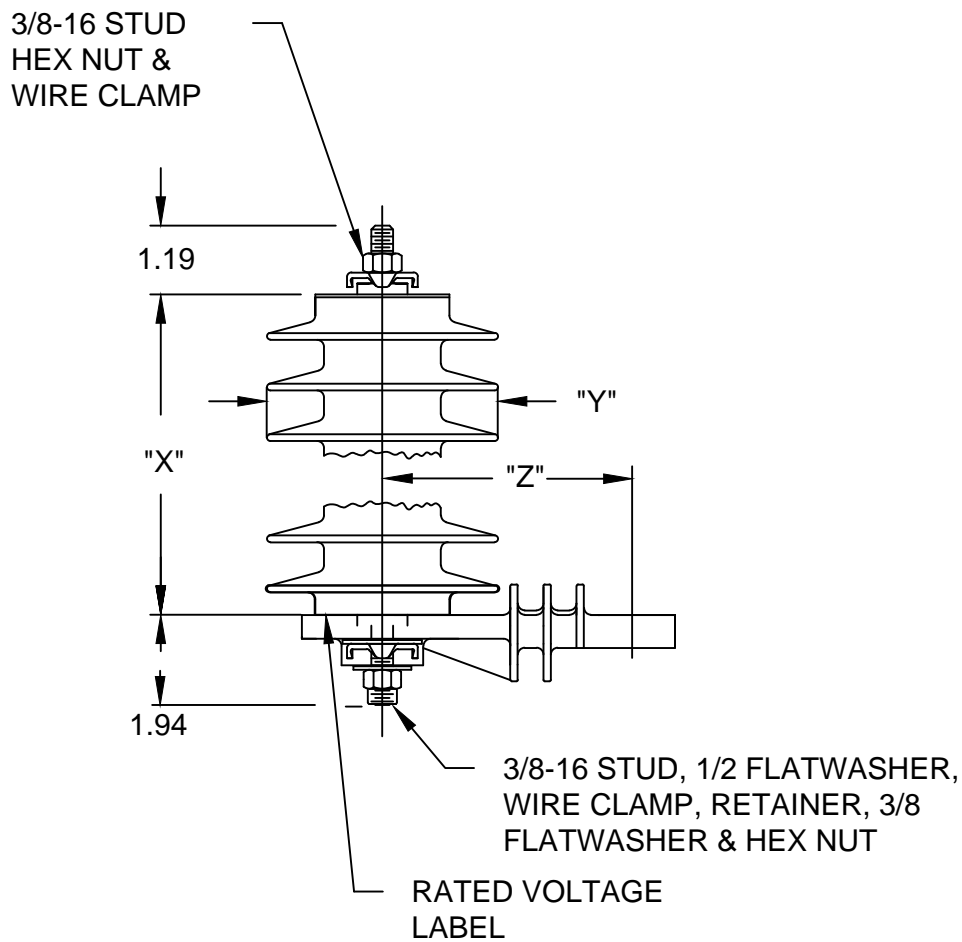

Voltage	MCOV	Creep		Strike		"X" Height		"Y" Dimension		"Z" Dimension		Mounting Clearance				Weight			
		kV rms	kV rms	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	lbs	kgs
3	2.55	8.5	216	3.8	97	3	76	4.1	104	6.8	172	5	127	3	76	2.9	1.3	5.4	2.5
6	5.1	11.3	287	4.6	117	3.8	96	4.1	104	6.8	172	5.4	137	3.4	86	3.3	1.5	5.8	2.6
9	7.65	14.4	366	5.7	145	4.9	124	4.1	104	6.8	172	6	152	4	102	3.8	1.7	6.3	2.9
10	8.4	14.4	366	5.7	145	4.9	124	4.1	104	7.56	192	6.2	157	4.2	107	3.8	1.7	6.3	2.9
12	10.2	17	432	6.6	168	5.4	137	4.1	104	7.56	192	7.5	191	5.5	140	4.3	1.9	6.8	3.1
15	12.7	25.2	640	8.8	223	7.8	198	4.1	104	7.56	192	8.5	216	6.5	165	5.6	2.5	8.1	3.7
18	15.3	25.2	640	8.8	223	7.8	198	4.1	104	7.56	192	9.5	241	7.5	191	5.6	2.5	8.1	3.7
21	17	28.1	714	9.7	246	8.6	218	4.1	104	8.56	217	10	254	8	203	6.2	2.8	8.7	4
24	19.5	36.5	927	12.4	315	11.5	292	4.1	104	8.56	217	12	305	10	254	8.3	3.8	10.8	4.9
27	22	39.6	1006	13.4	340	12.6	320	4.1	104	8.56	217	13	330	11	279	8.7	4	11.3	5.1
30	24.4	42.2	1072	14	356	13.1	332	4.1	104	8.56	217	14	356	12	305	9.2	4.2	11.7	5.3
36	29	50.4	1280	16.2	411	15.5	393	4.1	104	8.56	217	16.5	419	14.5	368	10.3	4.7	12.8	5.8

GE ENERGY FORT EDWARD, N.Y., U.S.A.	SIZE A	ANSI/IEEE C62.11	<h1>ARRESTER</h1> <h2>9L20BXX0**XHS</h2>
	DRAWN DCS	DATE 03/05/2015	
ISSUED	DATE 03/05/2015	SCALE	SHEET 1 CONT ON -

DISTR. TO